



Arbeitsschutz

Gebrauchsanleitung

Isolierstange IS ... STK

für Nennspannung bis 36 / 123 KV als

- Arbeitstange
- Schaltstange
- Erdungsstange

Inhaltsverzeichnis

Besondere Sicherheitshinweise.....	3
1. Allgemeine Anwendungsbestimmungen.....	4
2. Hinweise für die Benutzung	5
3. Anwendungshinweise	7
3.1 Isolierstange IS 36	7
3.1.1 Isolierstange, IS 36 ... 1000/1500	7
3.1.2 Isolierstange, IS STK	8
3.1.3 Handhabeverlängerungen, HV	9
3.1.4 Zubehör für Isolierstange IS	10
3.2 Benutzung, Montage/Demontage der Isolierstange IS	11
3.2.1 Kupplung, Isolierstange IS	12
3.2.1.1 Kupplung, Ausführung Spindel mit Sechskant	12
3.2.1.2 Kupplung, Ausführung Spindel mit Querstift.....	13
3.2.1.3 Adapter AES SQ SK mit Querstift / Spindel mit Sechskant	14
3.2.1.4 Schaltstangenkopf SSK M12 und SSK SQ	14
3.2.1.5 Schaltstangenkopf SSK M12 und SSK SQ fabrikfertige (typgeprüfte) Anlagen.....	15
3.2.1.6 Abschlusssteil	15
3.2.2 Kunststoff-Steckkupplung-System, Montage/Demontage.....	16
4. Anwendungskombinationen	17
4.1 Isolierstange IS 36 .. STK 1000 (mit Kunststoff-Steckkupplung-System)	17
4.2 Isolierstange IS 123 .. STK 2000	25
5. Wiederholungsprüfung.....	29
6. Reinigung und Pflege	29
7. Transport und Aufbewahrung.....	30
7.1 Transport	30
7.2 Aufbewahrung.....	30
7.3 Schutz vor UV-Strahlung	30

Besondere Sicherheitshinweise

Die Isolierstange IS darf nur von einer Elektrofachkraft oder einer elektrotechnisch unterwiesenen Person in Sinne von DIN VDE 0105-105: ... / EN 50110-1: ...) benutzt werden – sonst besteht Lebensgefahr !

Die Isolierstange IS darf nur eingesetzt werden, wenn die Sicherheitsvorkehrungen gegen Brand- und Explosionsgefahren berücksichtigt wurden (siehe B2 und B3 DIN VDE 0105-100 ... (EN 50110-1).

Vor dem Einsatz sind die Isolierstange IS sowie die für die Anwendung ausgewählten Handhabeverlängerungen HV STK ... auf ihren ordnungsgemäßen Zustand zu kontrollieren. Sollte eine Beschädigung oder ein sonstiger Mangel an den Teilen festgestellt werden, darf die Isolierstange IS und die ausgewählten Einzelteile nicht eingesetzt werden.

Die Isolierstange IS darf nur in den in dieser Gebrauchsanleitung beschriebenen Kombinationen verwendet werden.

Wird nur einer der angeführten Sicherheitshinweise nicht berücksichtigt oder missachtet, besteht Gefahr für Leib und Leben des Anwenders, außerdem ist die Anlagenverfügbarkeit gefährdet.

Veränderungen an der Isolierstange IS sowie den zugelassenen Arbeitsköpfen und Verlängerungen oder das Hinzufügen fabrikat- oder typfremder Komponenten gefährdet die Arbeitssicherheit, sind unzulässig und führen zum Erlöschen des Gewähranspruches.

1. Allgemeine Anwendungsbestimmungen

Bei der Anwendung der Isolierstange IS ist die DIN VDE 0105-100 zu beachten.

Die Isolierstange IS darf nur in Anlagen verwendet werden, für die diese durch entsprechende Aufschriften auf ihrem Typenschild (z.B. Nennspannung/Nennfrequenz) gekennzeichnet ist.

Die Isolierstange IS ist mit dem Schaltstangenkopf SSK SQ / SSK M12 als Schaltstange einsetzbar.

Die Isolierstange IS ist als Arbeitsstange zum Einbringen von isolierenden Schutzplatten, Bauform A3 geeignet.

Die Isolierstange IS ist als Erdungsstange zum Einbringen von Erdungs- und Kurzschließvorrichtungen geeignet.

Die Isolierstange IS darf bei der Anwendung nur an der Handhabe gefasst und von einem sicheren Standort aus geführt werden. Der Benutzer muss dabei von unter Spannung stehenden Anlagenteilen den notwendigen Sicherheitsabstand einhalten.

Die Isolierstange IS darf als Arbeitstange und Schaltstange nicht bei Niederschlägen verwendet werden.

Den Anforderungen der Isolierstange IS liegen die herabgesetzten Werte der Mindestabstände nach DIN VDE 0101: zugrunde.

Die Isolierstange IS ist daher nur bedingt in fabrikfertigen, typgeprüften Anlagen (nach DIN VDE 0670: ...) einsetzbar. Der Benutzer bzw. der Betreiber der Isolierstange IS muss sich beim Hersteller seiner fabrikfertigen, typgeprüften Schaltanlage erkundigen, ob und wo er diese Isolierstange IS einsetzen darf.

Bei der Anwendung der Isolierstange IS ist die entsprechende PSA (persönliche Schutzausrüstung) bestehend aus:

-Helm mit Gesichtsschutz
-Schutzhandschuhe

- ...

zu tragen.

Bei der Anwendung der Isolierstange IS müssen die vorgegebenen Grenzwerte –25 °C bis + 55 °C Temperatur und 20 % bis 96 % rel. Feuchte eingehalten werden.

2. Hinweise für den Benutzer

Bei der Anwendung sind nachfolgende Punkte unbedingt zu beachten:

- 2.1 Alle Einzelteile sind vor der Montage und Anwendung einer Sichtprüfung auf mechanische Schäden z.B. nicht festsitzende Handschutzteller und Roter Ring, Risse, tiefe Kratzspuren, Funktion der Steckkupplung zu überprüfen.
- 2.2 Defekte Einzelteile sind aus Sicherheitsgründen einer Weiterverwendung zu entziehen.
- 2.3 Leicht verschmutzte Einzelteile sind vor dem Zusammenbau mit einem sauberen, fusselfreien Tuch zu reinigen.
- 2.4 Stark verschmutzte Einzelteile (festsitzende Beläge) an Einzelteilen sind mit den in dieser Gebrauchsanleitung aufgeführten zugelassenen Reinigungsmittel zu entfernen (siehe Pkt. 6, Seite 30).
- 2.5 Betaute, feuchte Einzelteile (z.B. hervorgerufen durch extreme Temperaturschwankung) sind vor der Anwendung trocken zu wischen, gegebenenfalls ist abzuwarten bis die Einzelteile die Umgebungstemperatur angenommen haben.
- 2.6 Bei der Anwendung der Isolierstange IS sind die in dieser Gebrauchsanleitung angeführten Hinweise zu beachten und einzuhalten.
- 2.7 Die Isolierstange IS darf bei der Anwendung nur an der Handhabe gefasst werden.
- 2.8 Der für die Nennspannung bemessene Isolierteil ist durch die Begrenzungsscheibe und den Roten Ring gekennzeichnet (siehe Fig. 3.2, Seite 11 und 3.2.1.1 Seite 12).
- 2.9 Das Auflegen auf geerdete Anlagenteile ist über die gesamte Länge der Isolierstange IS erlaubt.
- 2.10 Das Auflegen auf unter Spannung stehende Anlagenteile ist nur oberhalb vom Roten Ring der Isolierstange IS erlaubt.

- 2.11 Die Isolierstange IS ist als Schaltstange und Arbeitsstange in Innenraum- und Freiluftanlagen jedoch nicht bei Niederschlägen (Regen, Nebel, ..) einsetzbar.
In der Anwendung zum Einbringen von isolierenden Schutzplatten, Bauform A3 sind die Anwendungshinweise zulässiges Plattengewicht entsprechend der Gesamtlänge zu beachten (siehe Anwendungskombinationen ab Seite 18).
- 2.12 Die Isolierstange IS ist als Erdungsstange in Innenraumanlagen und an Freiluftanlagen bei allen Witterungseinfüssen (Nebel, Regen, ..) einsetzbar.
In der Anwendung zum Einbringen von Erdungs- und Kurzschließvorrichtungen sind die Anwendungshinweise zulässige Kopflast entsprechend der Gesamtlänge zu beachten (siehe Anwendungskombinationen ab Seite 18).
- 2.13 Bei der Anwendung der Isolierstange IS als Schaltstange, Arbeitsstange oder Erdungsstange sind die vorgegebenen Grenzwerte –25 °C bis + 55 °C Temperatur und 20 % bis 96 % rel. Feuchte einzuhalten.
- 2.14 Die Isolierstange IS und Zubehörteile sind vor Verschmutzung und Schäden beim Transport zu schützen. Es wird empfohlenen die Einzelteile in der dafür vorgesehenen Transporttasche (siehe Pkt. 7, Seite 31) zu transportieren und aufzubewahren.
- 2.15 Beim Transport und Lagerung der Isolierstange IS und Zubehörteile ist der Temperaturbereich –25°C bis + 70°C sowie die Grenzwerte der relativen Luftfeuchte 20% bis 70% zu beachten.

3. Anwendungshinweise

3.1 Isolierstange IS 36 ...

3.1.1 Isolierstange, IS 36 ... 1000/1500

Die **Isolierstange** IS 36 ... 1000/1500 ist als **Arbeitsstange** zum Einbringen von isolierenden Schutzplatten (DIN VDE 0682-522), mit **Schaltstangenkopf** als **Schaltstange** (DIN VDE 0681-1-2) und zum Einbringen von Erdungs- und Kurzschließvorrichtungen als **Erdungsstange** geeignet (siehe Fig. 3.1.1).


Typenschild



Typenschild




Typkodierung: für Isolierstange IS 36 ...

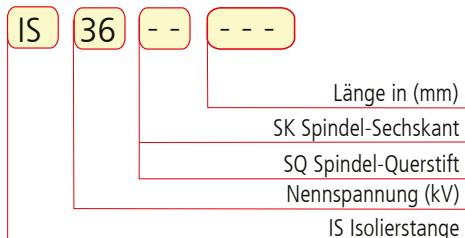

IS 36 SQ ...
Spindel mit Querstift

IS 36 SK ...
Spindel mit Sechskant

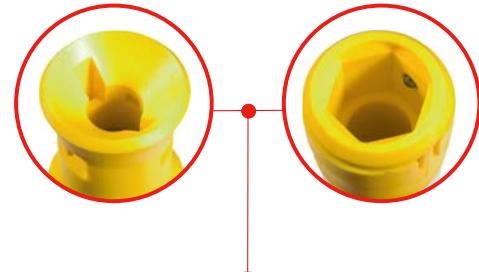

Höchstzulässiges Plattengewicht als Arbeitsstange: Isolierstange IS 36 ...

IS 36 SQ 1000, Plattengewicht 6,6 kg (Ausführung, Spindel mit Querstift)
IS 36 SQ 1500, Plattengewicht 5,6 kg (Ausführung, Spindel mit Querstift)

Höchstzulässige Kopflast, als Erdungsstange: Isolierstange IS 36 ...

IS 36 SK 1000, Kopflast 12 kg	(Ausführung, Spindel mit Sechskant)
IS 36 SK 1500, Kopflast 9 kg	(Ausführung, Spindel mit Sechskant)
IS 36 SQ 1000, Kopflast 12 kg	(Ausführung, Spindel mit Querstift)
IS 36 SQ 1500, Kopflast 9 kg	(Ausführung, Spindel mit Querstift)

3.1.2 Isolierstange, IS STK ...

Die Isolierstange IS STK ... ist als Arbeitsstange zum Einbringen von isolierenden Schutzplatten (DIN VDE 0682-522), mit Schaltstangenkopf als Schaltstange (DIN VDE 0681-1-2) und als Erdungsstange zum Einbringen von Erdungs- und Kurzschließvorrichtungen geeignet.

Die Isolierstange IS STK ... ist am unteren Ende der Handhabe mit einer Kunststoff-Steckkupplung zur Handhabeverlängerung ausgerüstet!

Das Kunststoff-Steckkupplungs-System ermöglicht eine individuelle Handhabeverlängerung.

Mögliche Kombinationen sowie die maximalen zulässigen Gesamtlängen können aus den "Anwendungskombination" ab der Seite 18 entnommen werden!


Typenschild



Typenschild



Typcodierung: für Isolierstange IS

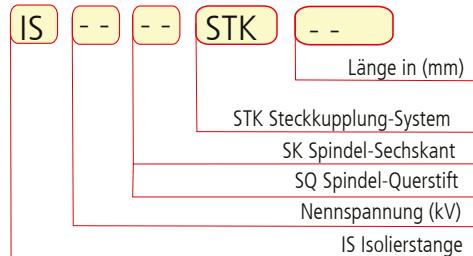

Höchstzulässiges Plattengewicht in kg als Arbeitsstange: Isolierstange IS ...

- IS 36 SQ STK 1000, Plattengewicht 6,6 kg (Ausführung, Spindel mit Querstift)
- IS 123 SQ STK 2000, Plattengewicht 4,6 kg (Ausführung, Spindel mit Querstift)


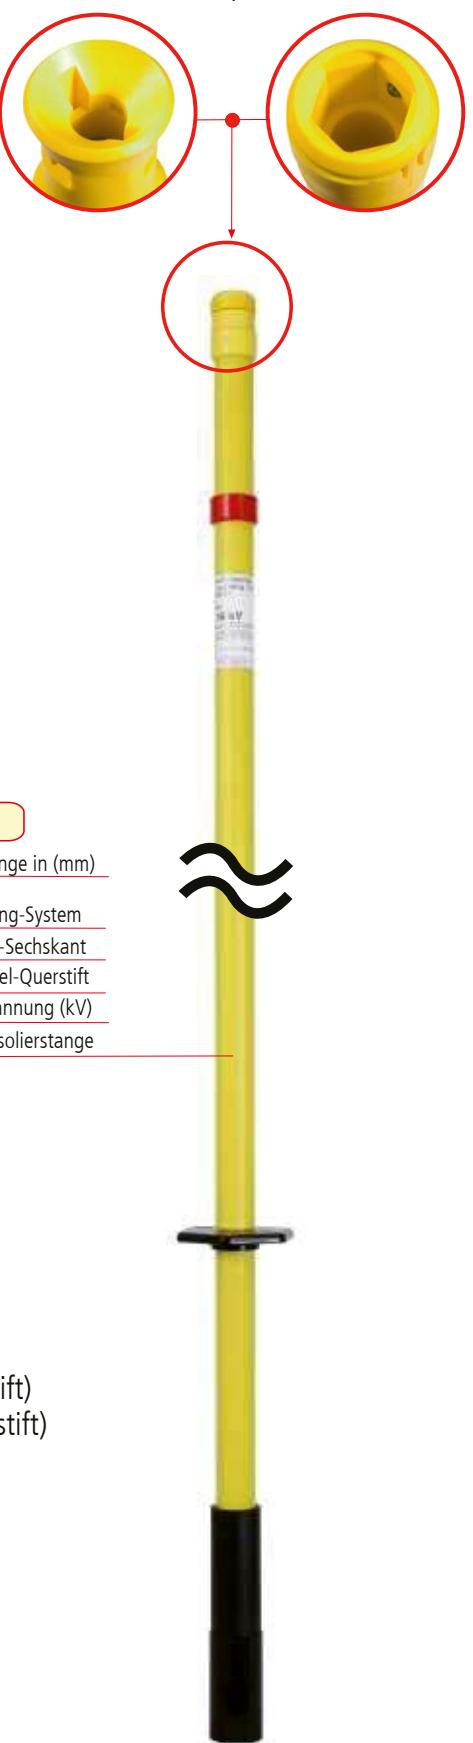


Fig. 3.1.2

3.1.3 Handhabeverlängerungen HV STK...

Zur Verlängerung der Isolierstange IS ... STK ... stehen nachfolgende Handhabenverlängerungen HV STK ... zur Verfügung. Bei der Zusammenstellung dürfen nur die von **DEHN** zugelassenen Kombinationen eingesetzt werden (siehe nachfolgende Anwendungskombinationen ab Seite 18).

Typkodierung:

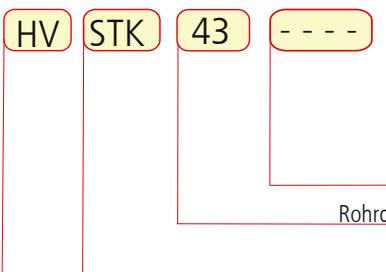

Länge in (mm)

Rohrdurchmesser in (mm)

STK Steckkupplung

HV Handhabeverlängerung

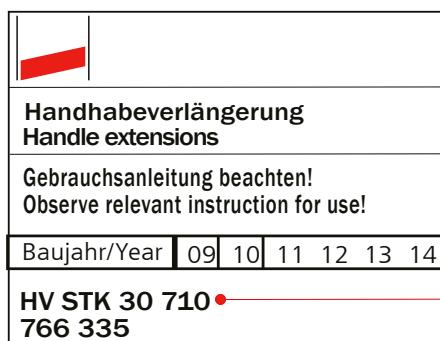


Fig. 3.1.3

3.1.4 Zubehör für Isolierstange IS ...

Nachfolgende Zubehörteile können individuell in Kombination mit der Isolierstange IS ... eingesetzt werden:

Schaltstangenkopf mit Gewinde M12
SSK M12



Typkodierung:
SSK M12
 M12 Gewinde
 SSK Schaltstangenkopf

Schaltstangenkopf mit Spindel-Querstift
SSK SQ



Typkodierung:
SSK SQ
 SQ Spindel-Querstift
 SSK Schaltstangenkopf

Abschlussteil
AR STK



Hinweis:
 Das Abschlussteil A STK wird als mechanischer Schutz der Kunststoff-Steckkupplung am Ende der Handhabe und am Ende der Handhabeverlängerung HV STK ... empfohlen.

Kunstledertasche
KLT 133 34 10



Haltevorrichtungen
 HV P ST D30
 (für Rohrdurch-
 messer 30 mm)
 oder
 HV P ST D40 45
 (für Rohrdurch-
 messer 40-45 mm)



3.2. Anwendung und Bedienung, Montage/ Demontage der Isolierstange IS ...



Die Isolierstange IS ... kann als Arbeitsstange, Schaltstange oder Erdungsstange eingesetzt werden:

- Als **Arbeitsstange** zum Handhaben von isolierenden Schutzplatten nach DIN VDE 0682 Teil 552 (siehe ab Seite 17).
- Als **Schaltstange** nach DIN VDE 0681-1-2 zum Schalten von Lasttrenn- und Erdungsschaltern (siehe ab Seite 17).
- Als **Erdungsstange** zum Heranführen der Anschließteile von Erdungs- und Kurzschließvorrichtungen an Starkstromanlagen zum Erden und Kurzschließen (siehe ab Seite 17).

Die **Isolierstange IS ...** besteht aus **Kupplung** ①, **Roten Ring** ②, **Isolierteil** ③, **Begrenzungsscheibe (Handschutzteller)** ④, **Handhabe** ⑤ und **Abschlussteil** ⑥ (siehe Fig. 3.2)

In der Anwendung als **Arbeitsstange** und **Erdungsstange** ist die **Isolierstange IS ...** entsprechend dem Gewicht der einzubringenden Schutzplatten oder Erdungs- und Kurzschließvorrichtung auszuwählen (Plattengewicht / Kopflast in kg), siehe Anwendungskombinationen, Pkt. 4, Seite 17.

Die **Isolierstange IS ...** darf beim Benutzen nur an der **Handhabe** ⑤ gefasst werden (nicht über die **Begrenzungsscheibe** ④ hinausfassen).

Der für die Nennspannung bemessene **Isolierteil** ③ ist durch die **Begrenzungsscheibe** ④ und den **Roten Ring** ② gekennzeichnet (siehe Fig. 3.2).

IS ... SQ,
Spindel mit Querstift **IS ... SK**,
Spindel mit Sechskant

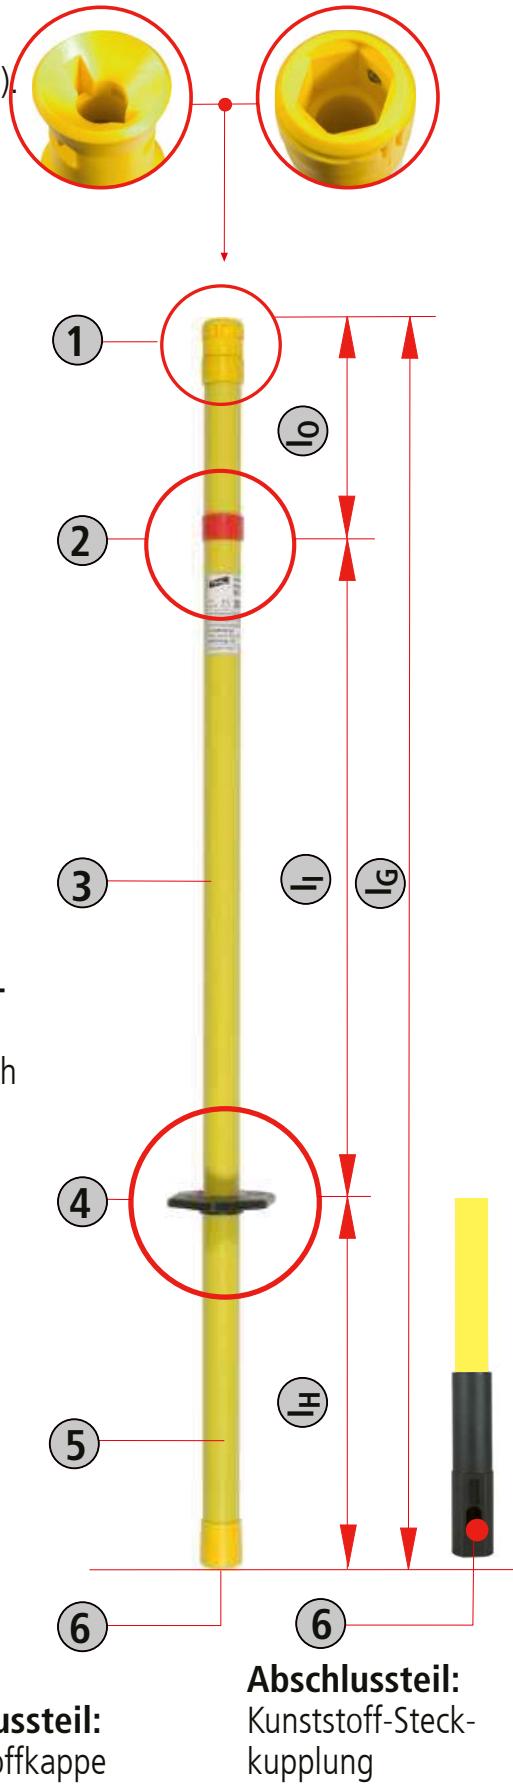


Fig. 3.2

3.2.1 Kupplung, Isolierstange IS ...

3.2.1.1 Kupplung, Ausführung Spindel mit Sechskant (Kunststoffkupplung, gelb)

Die Kupplung in der Ausführung Spindel mit Sechskant ermöglicht eine einfache Montage und Demontage des Anschließteiles.

Bei Verwendung von **Anschließteilen** mit Sechskantbolzen wird das Anschließteil nur durch die Federkraft der Kupplung gehalten. Auf einen festen Sitz ist zu achten! (siehe Fig. 3.2.1.1).

Die Kupplung, Ausführung Spindel mit Sechskant ermöglicht das Aufschrauben des **Schaltstangenkopfes** SSK M12. Vor der Anwendung mit der **Isolierstange IS ...** ist der **Schaltstangenkopf** SSK M12 auf festen Sitz zu überprüfen (siehe Fig. 3.2.1.1).

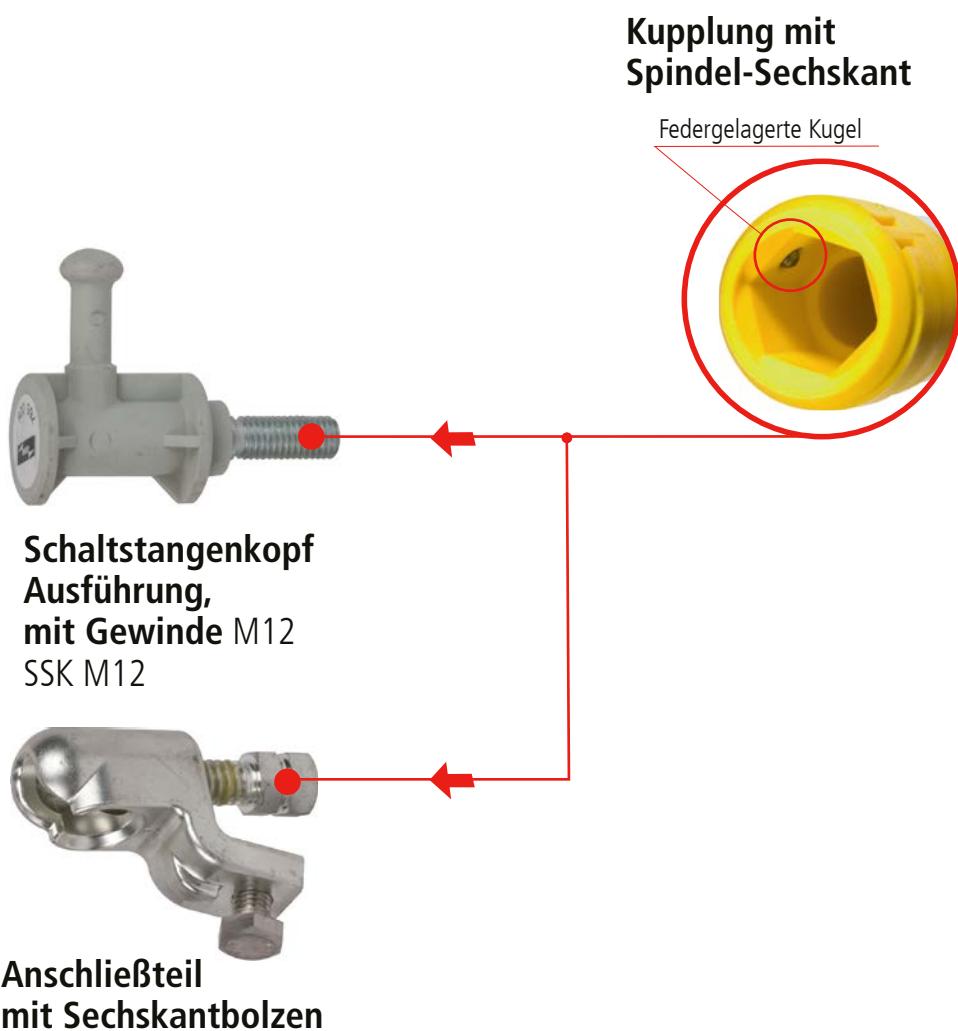


Fig. 3.2.1.1

3.2.1.2 Kupplung, Ausführung Spindel mit Querstift für Innenraumanlagen (Kunststoffkupplung gelb für kurze Spindel)

Zur Montage / Kontaktierung und Demontage des Anschließteiles an der Schutzplatte oder an der E+K-Vorrichtung muss mit der **Isolierstange IS ...** eine Schub- / Drehbewegung gemacht werden (siehe Fig. 3.2.1.2).

Montage/Kontaktierung des Anschließteiles (Spindel, Schutzplatte Bauform A3)

Einführen der Spindel in die Kupplung bis zum fühlbaren Anschlag.

Bei Erreichen des fühlbaren Anschlages ist die Isolierstange IS ... um 90° nach Links zu drehen.

Das Anschließteil (Spindel, Schutzplatte Bauform A3) der Schutzplatte, Schaltstangenkopf oder der E+K-Vorrichtung ist danach fest in der Kupplung arretiert.

Demontage des Anschließteiles (Spindel)

Zum Abnehmen, Lösen des Anschließteiles (Spindel) muss mit der Isolierstange IS ... eine Schub- / Dreh-/ Ziehbewegung ausgeführt werden.

Bei Erreichen des fühlbaren Anschlages ist die Isolierstange IS ... um 90° nach Rechts zu drehen und danach abzuziehen.

Montage Schub- / Drehbewegung

Demontage Schub- / Dreh- / Ziehbewegung

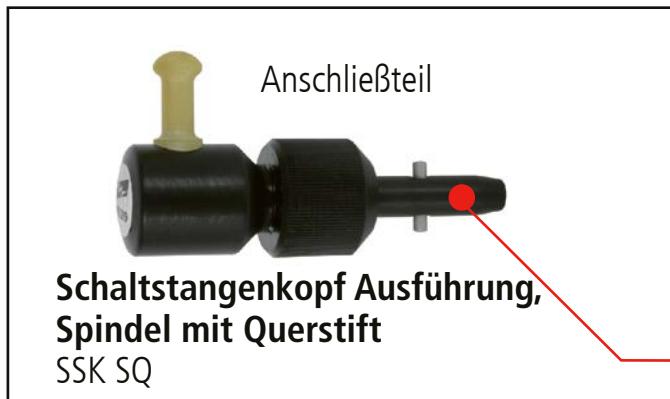
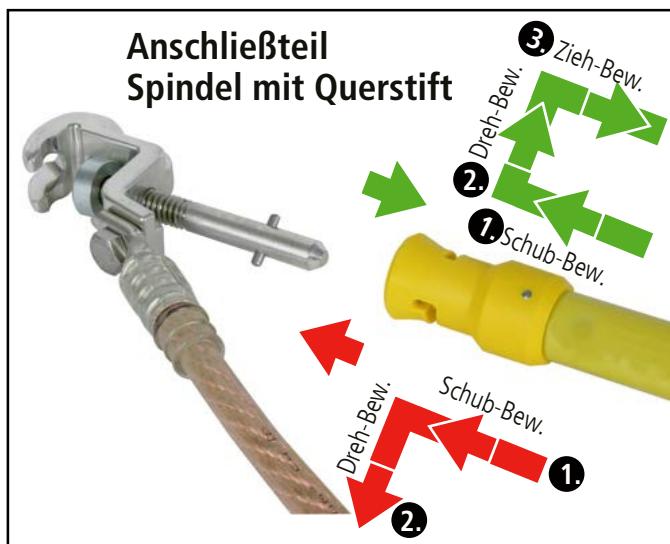


Fig. 3.2.1.2

3.2.1.3 Adapter, Spindel mit Querstift / Spindel mit Sechskant

Mit dem Adapter AES SQ SK kann die Isolierstange IS 36 SQ ... mit der Kupplung, Ausführung Spindel mit Querstift für Anschließteile der Ausführung Spindel mit Sechskant aufgerüstet werden (siehe Fig. 3.2.1.3).

Der Adapter AES SQ SK kann bei nachfolgenden Isolierstangen IS ... (Spindel mit Querstift) verwendet werden:

Isoliersstange IS ... Ausführung, Spindel mit Querstift, Typ:

- IS 36 SQ 1000
- IS 36 SQ 1500
- IS 36 SQ STK 1000
- IS 123 SQ STK 2000

Achtung:

Der Adapter AES SQ SK ist mit einer Kunststoff-Rändelmutter ① ausgerüstet. Nach dem Einsetzen in die Kupplung, Ausführung Spindel mit Querstift muss der Adapter mit der Kunststoff-Rändelmutter fest verschraubt werden (siehe Fig. 3.2.1.3)!



Fig. 3.2.1.3

3.2.1.4

Schaltstangenkopf SSK SQ

Mit dem Schaltstangenkopf SSK SQ (Ausführung, Spindel mit Querstift) kann die Isolierstange IS ... SQ ... zur Schaltstange aufgerüstet werden!

Achtung:

Der Schaltstangenkopf SSK SQ ist mit einer Kunststoff-Rändelmutter ① ausgerüstet.

Nach dem Einsetzen in die Kupplung, Ausführung Spindel mit Querstift muss der Schaltstangenkopf SSK SQ mit der Kunststoff-Rändelmutter fest verschraubt werden (siehe Fig. 3.2.1.4)!

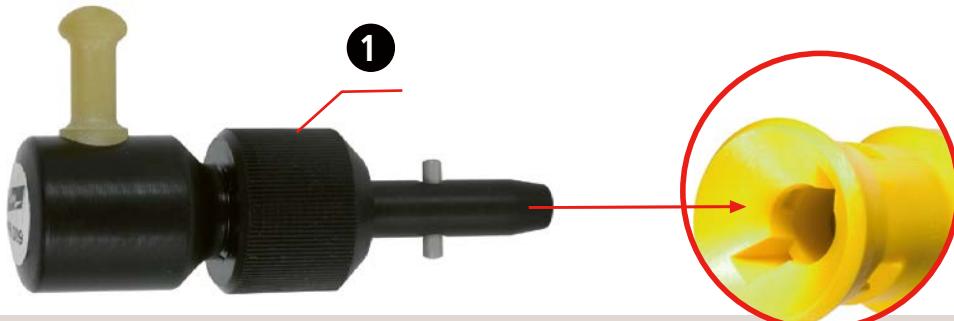


Fig. 3.2.1.4

3.2.1.5 Schaltstangenkopf SSK M12 und SSK SQ fabrikfertige (typgeprüfte) Anlagen

Die Isolierstange IS ... mit aufgeschraubten / aufgesetzten Schaltstangenkopf SSK ... ist nur bedingt in fabrikfertigen (typgeprüften) Anlagen einsetzbar! Der Benutzer oder der Betreiber muss sich beim Hersteller der fabrikfertigen Schaltanlage erkundigen, ob und wo er die Isolierstange IS ... mit Schaltstangenkopf SSK ... einsetzen darf (siehe Fig. 3.2.1.5).

**Schaltstangenkopf
Ausführung,
mit Gewinde M12
SSK M12**



**Schaltstangenkopf Ausführung,
Spinel mit Querstift
SSK SQ**



Fig. 3.2.1.5

3.2.1.6 Abschlussteil

Das **Abschlussteil A STK** wird als mechanischer Schutz der Kunststoff-Steckkupplung am Ende der Handhabe der Isolierstange IS ... und am Ende der Handhabeverlängerung HV ... empfohlen (siehe Fig. 3.2.1.5).



Abschlussteil A STK



Isolierstange IS ..., Handhabeverlängerung HV ...

Fig. 3.2.1.6

3.2.2 Steckkupplungs-System zur Handhabeverlängerung von Isolierstangen IS ... STK ..

Montage und Demontage der Handhabeverlängerungen und Abschlussteile

Montage der Handhabeverlängerung, Abschlussteil

Die Isolierstange IS ... und die Handhabeverlängerung HV ... ist mit einem Kunststoff-Steckkupplungs-System ausgerüstet, das die Kombination auch unterschiedlicher Rohrdurchmesser sicherstellt. Zur Montage muss der Druckknopf an der Handhabeverlängerung oder Abschlussteil gedrückt werden.

Die beiden Kupplungsteile lassen sich anschließend leicht zusammenstecken. Bei ordnungsgemäßen Sitz der Kupplungsteile muss der gelbe Druckknopf in das Langloch des Buchsenteiles einrasten. Die zusammengesteckte Kunststoff-Steckkupplung ist vor der Anwendung auf festen Sitz zu überprüfen (siehe Fig. 3.2.2).

Demontage der Handhabeverlängerung, Abschlussteil

Zum Lösen der Steckkupplung ist der gelbe Druckknopf soweit einzudrücken, dass sich die beiden Kupplungsteile leicht auseinander ziehen lassen.

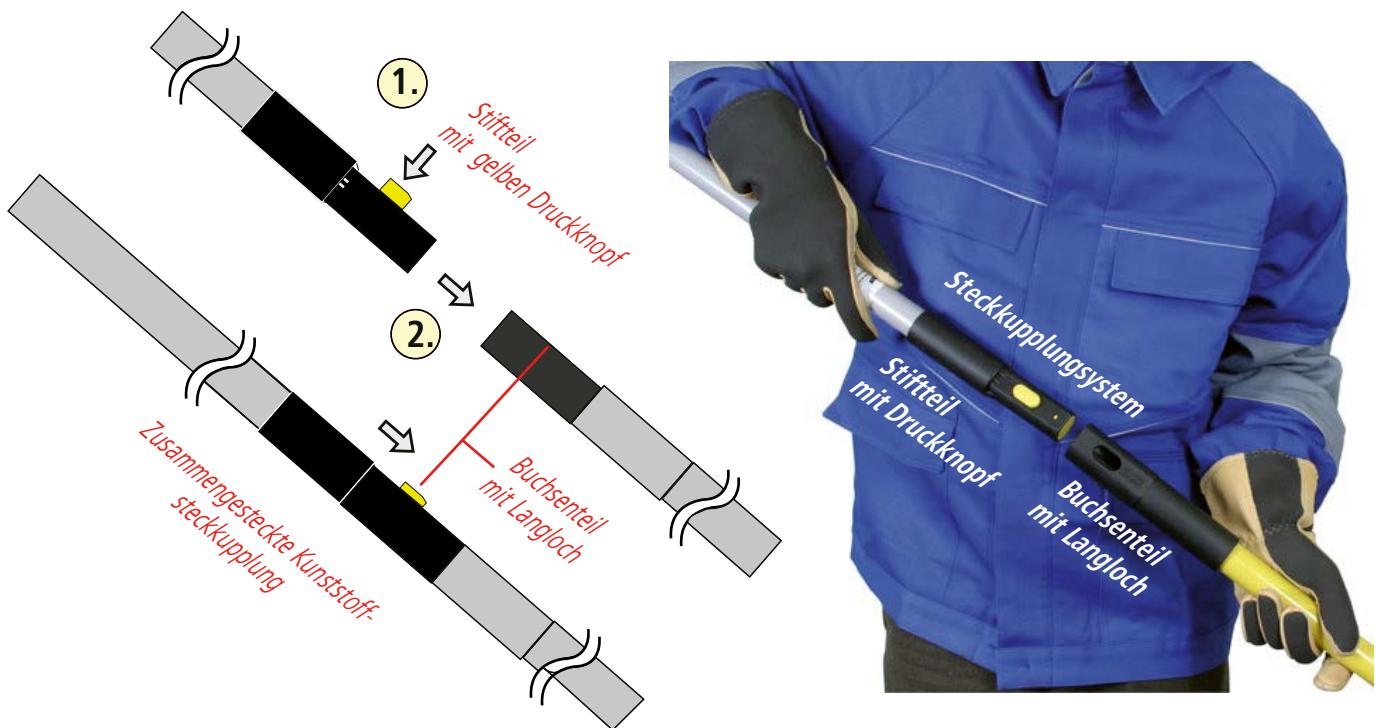


Fig. 3.2.2

4. Anwendungskombinationen

4.1 Isolierstange IS 36 .., IS 36 SK STK 1000, IS 36 SQ STK 1000

Die Isolierstange IS 36 .. STK 1000 mit Kunststoff-Steckkupplung als Abschlussteil zur Handhabeverlängerung steht in zwei Ausführungen für die Aufnahme von Anschließteilen der Ausführungen "Spindel mit Sechskant und Spindel mit Querstift" zur Verfügung (siehe Fig. 4.1 sowie Seite 18-24 "Anwendungskombinationen").

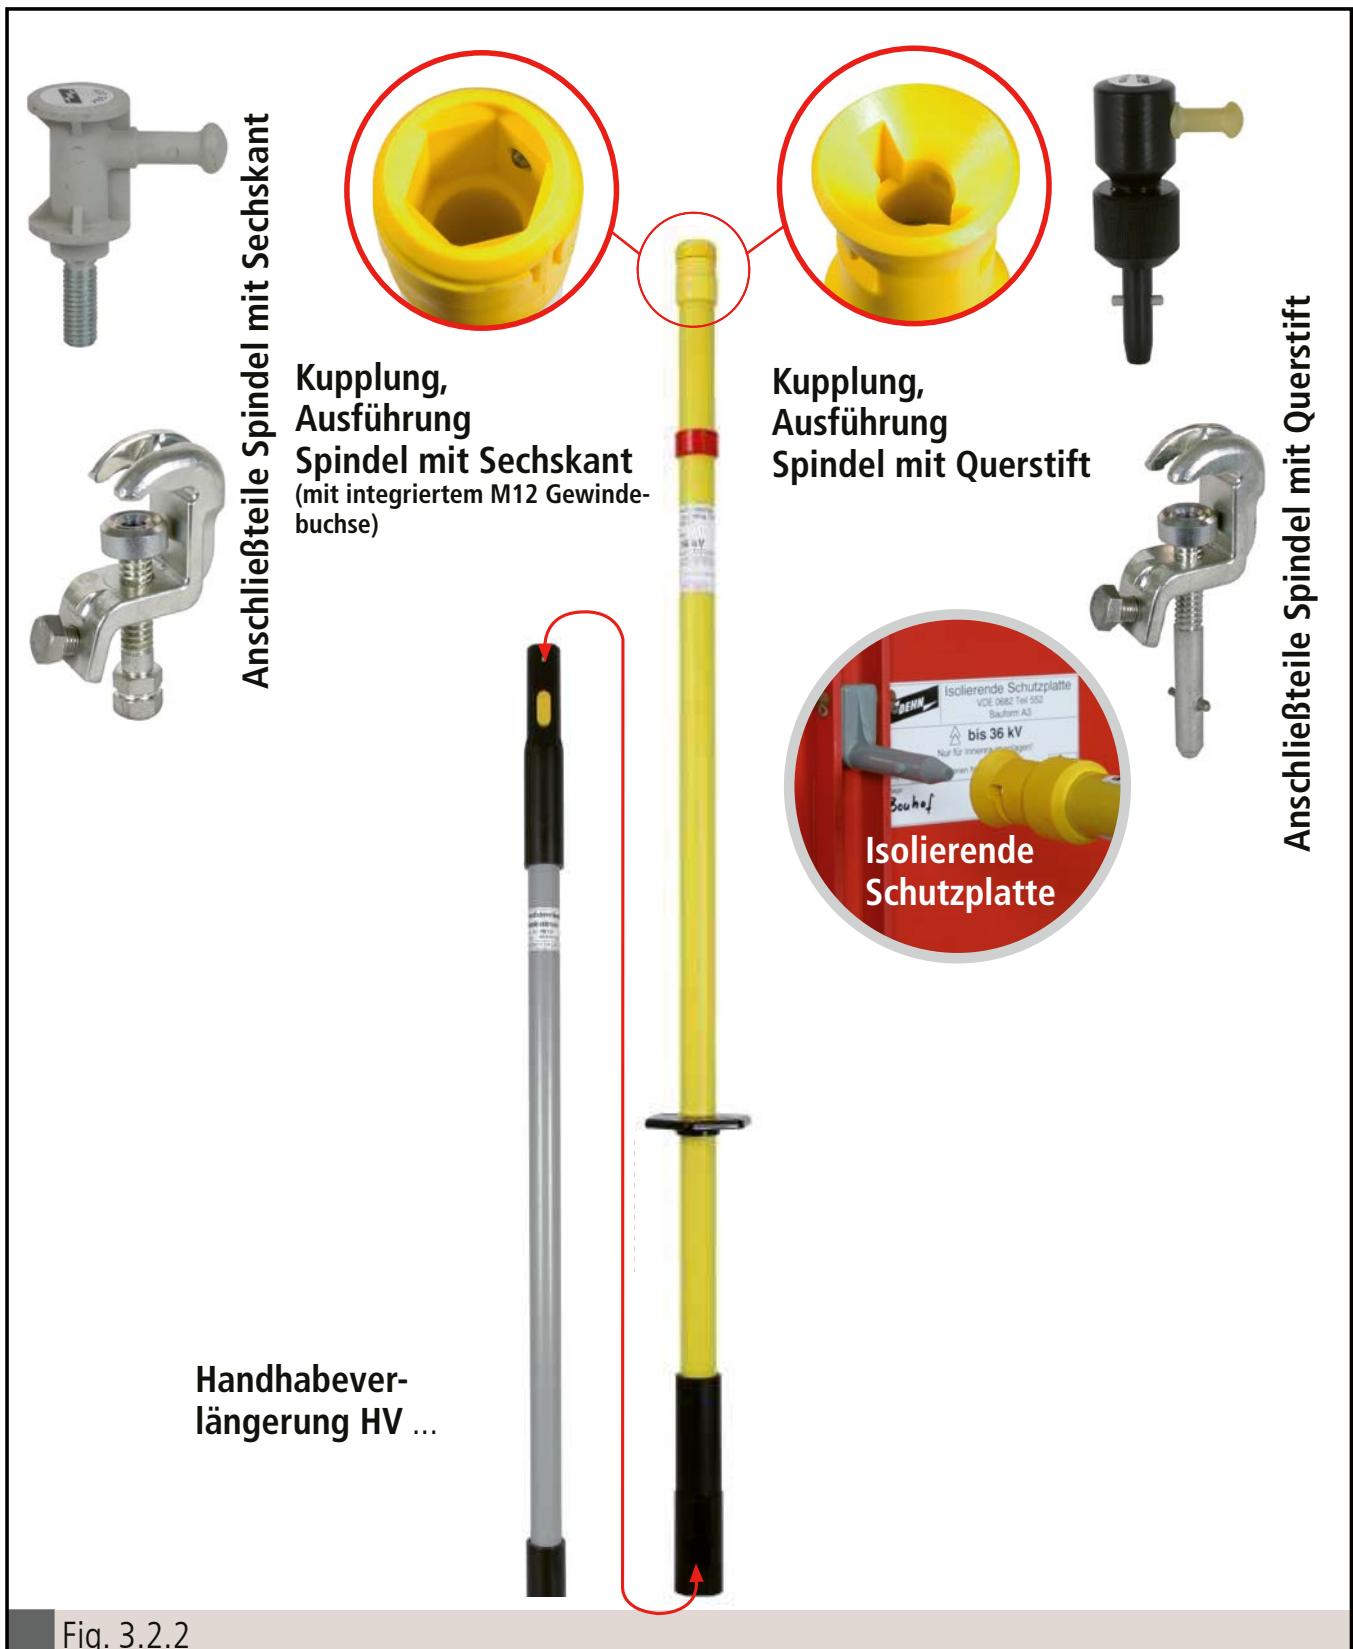


Fig. 3.2.2

4.1.1 Anwendungskombinationen, Isolierstange IS ... als Arbeitsstange zum Einbringen von isolierenden Schutzplatten, Bauform A3, (Ausführung, Spindel mit Querstift) oder Schwenkschubplatten

Kombination A

Handhabeverlängerung HV STK 30 710 +
Isolierstange IS 36 SQ STK 1000



Kombination B


2 x Handhabeverlängerung HV STK 30 710 +
Isolierstange IS 36 SQ STK 1000



Anwendungskombinationen, Isolierstange IS ... als Arbeitsstange zum Einbringen von isolierenden Schutzplatten, Bauform A3, (Ausführung, Spindel mit Querstift) oder Schwenkschubplatten

Kombination C

Handhabeverlängerung HV STK 43 910 +
Isolierstange IS 36 SQ STK 1000

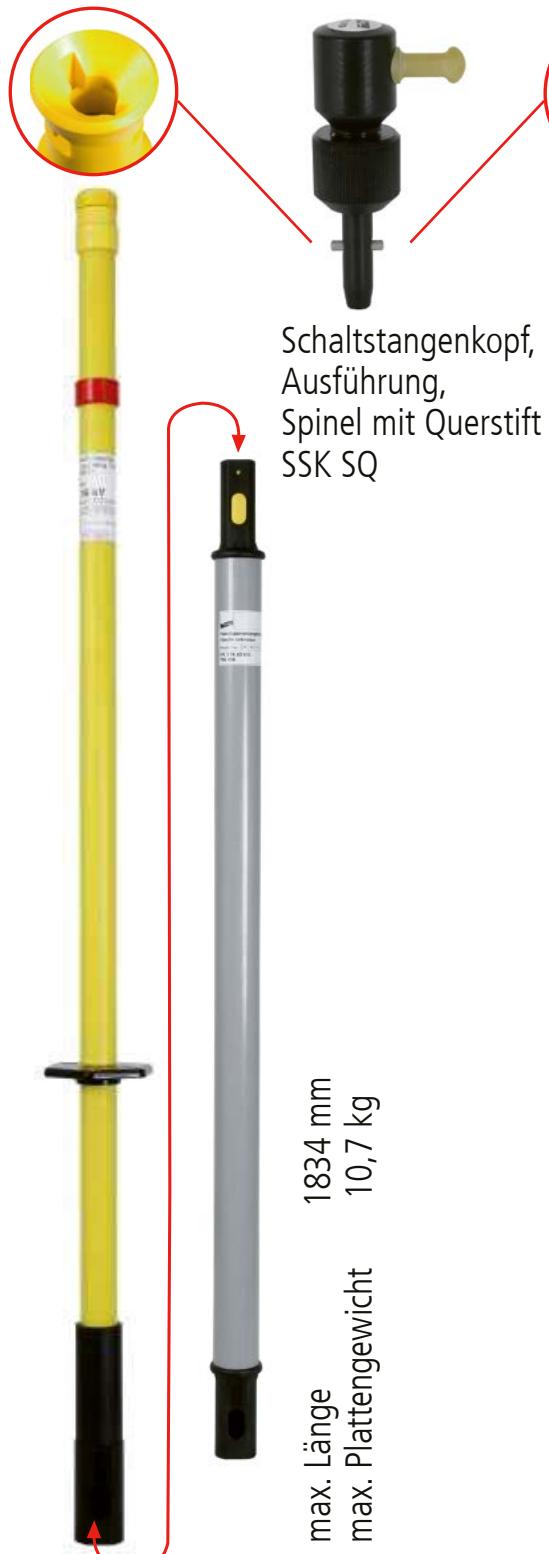

Kombination D


2 x Handhabeverlängerung HV STK 43 910 +
Isolierstange IS 36 SQ STK 1000



Anwendungskombinationen, Isolierstange IS ... als Arbeitsstange zum Einbringen von isolierenden Schutzplatten, Bauform A3, (Ausführung, Spindel mit Querstift) oder Schwenkschubplatten

Kombination E


Handhabeverlängerung HV STK 43 1280 +
Isolierstange IS 36 SQ STK 1000

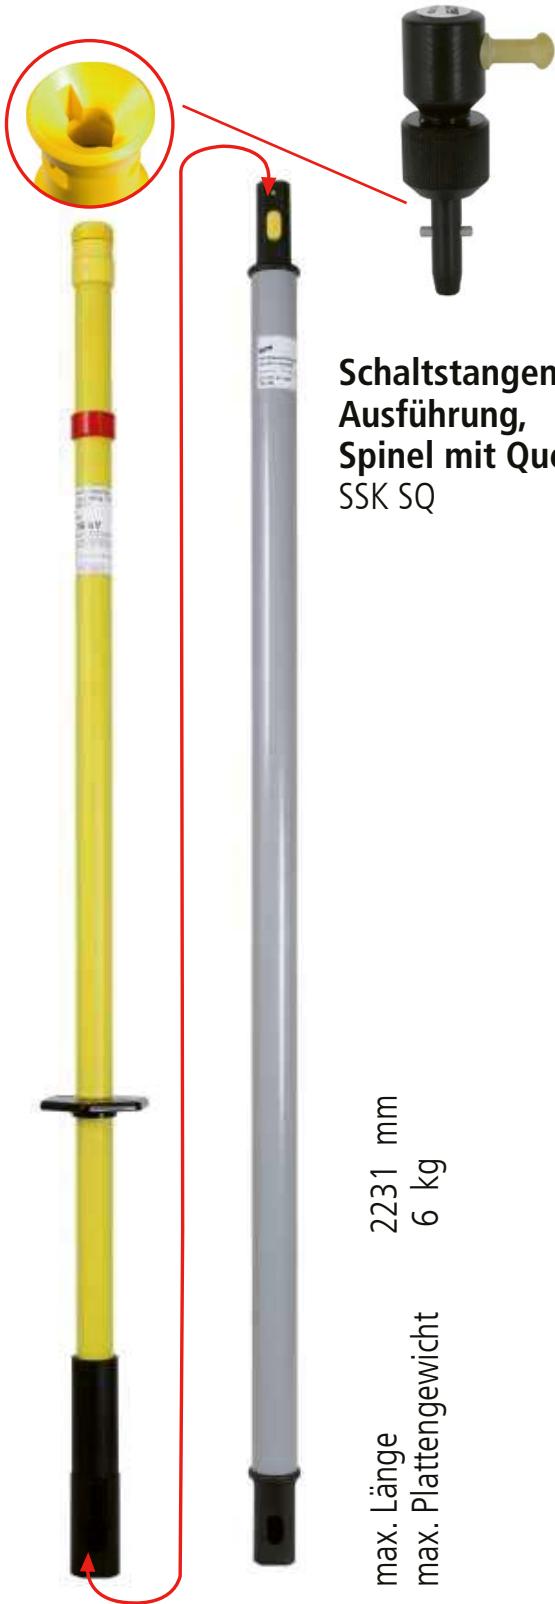

4.1.2 Anwendungskombinationen, Isolierstange IS ... als Schaltstange


Kombination A

1 x Handhabeverlängerung HV STK 30 710 +
Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000
+ Schaltstangenkopf SSK M12 oder
SSK SQ

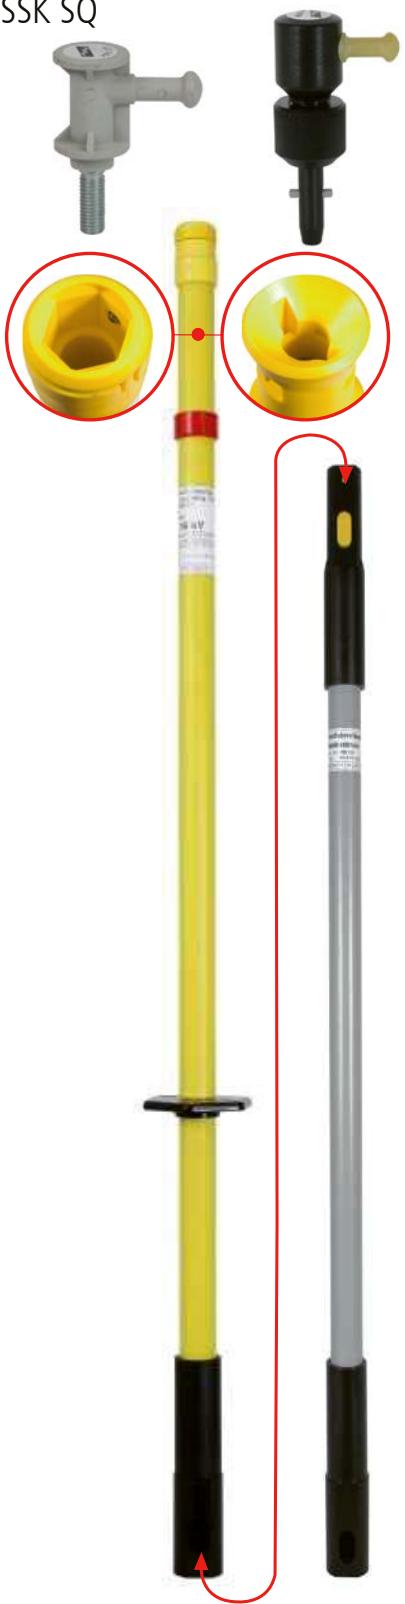

Kombination B


1 x Handhabeverlängerung HV STK 43 910
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000
+ Schaltstangenkopf SSK M12 oder SSK SQ

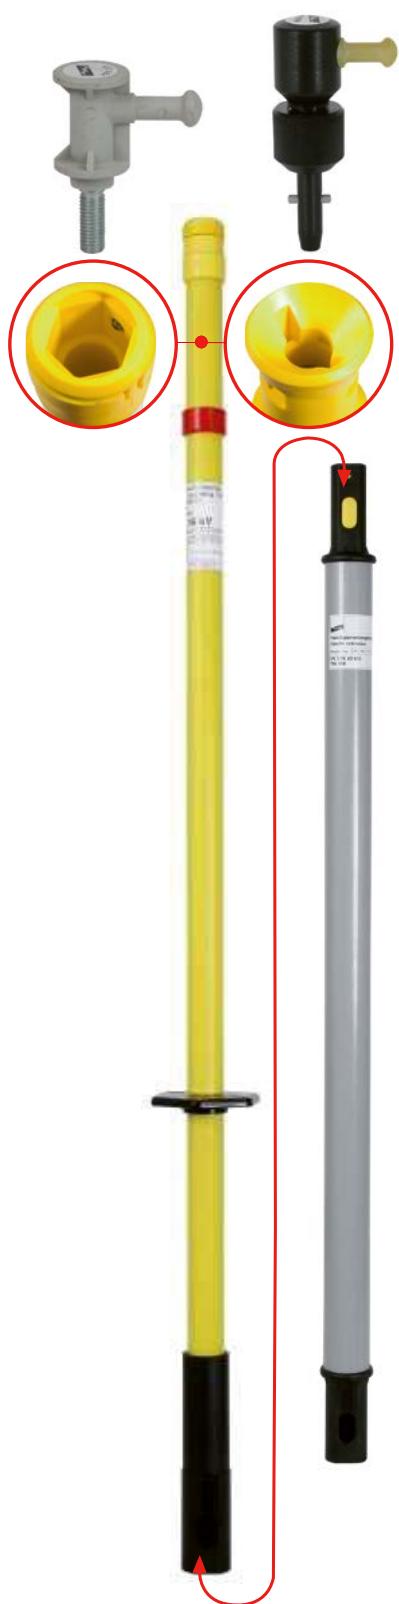

Anwendungskombinationen, Isolierstange IS ... als Schaltstange

Kombination C


Handhabeverlängerung HV STK 43 1280
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000
+ Schaltstangenkopf SSK M12 oder SSK SQ

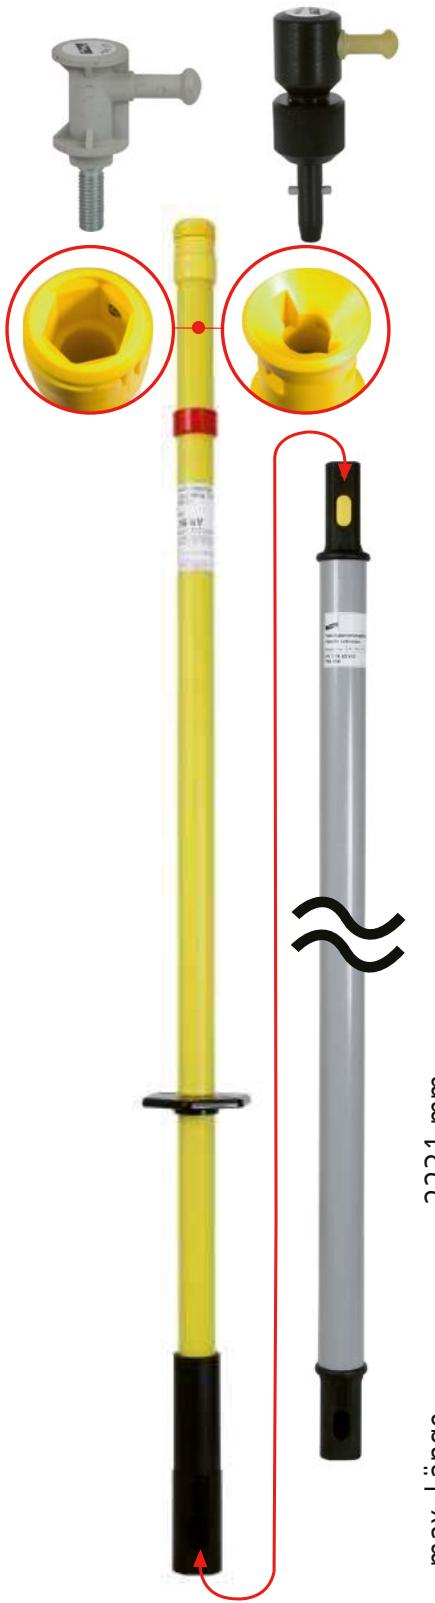

4.1.3 Anwendungskombinationen, Isolierstange IS ... als Erdungsstange

Kombination A

1 x Handhabeverlängerung
HV STK 30 710
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000

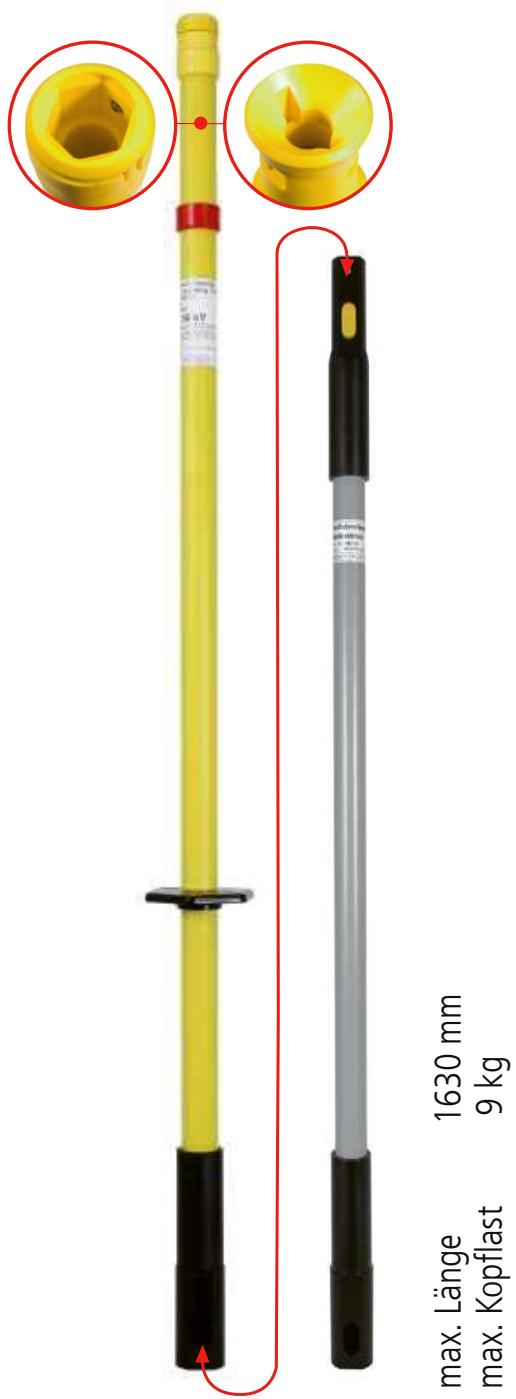

Anwendungskombinationen, Isolierstange IS ... als Erdungsstange


Kombination B

1 x Handhabeverlängerung
HV STK 43 910
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000



Kombination C


2 x Handhabeverlängerung
HV STK 43 910
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000

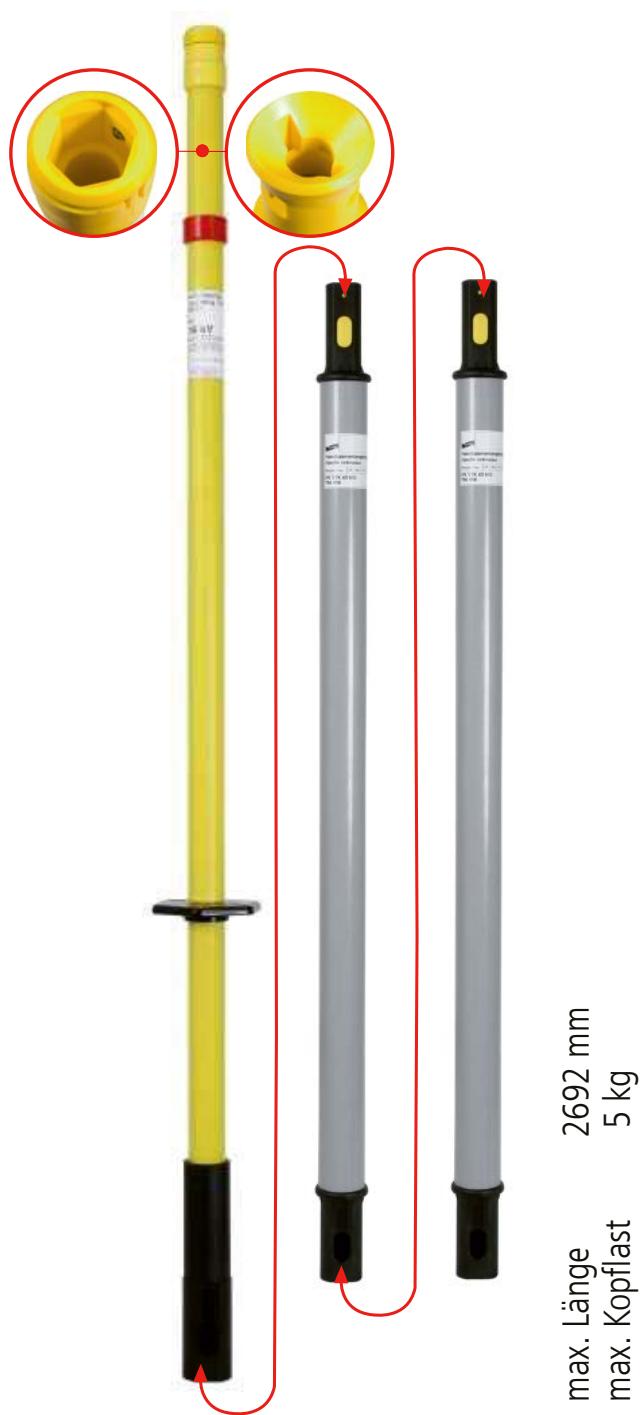

Anwendungskombinationen, Isolierstange IS ... als Erdungsstange

Kombination D


1 x Handhabeverlängerung
HV STK 43 1280
+ Isolierstange IS 36 SK STK 1000 oder
Isolierstange IS 36 SQ STK 1000

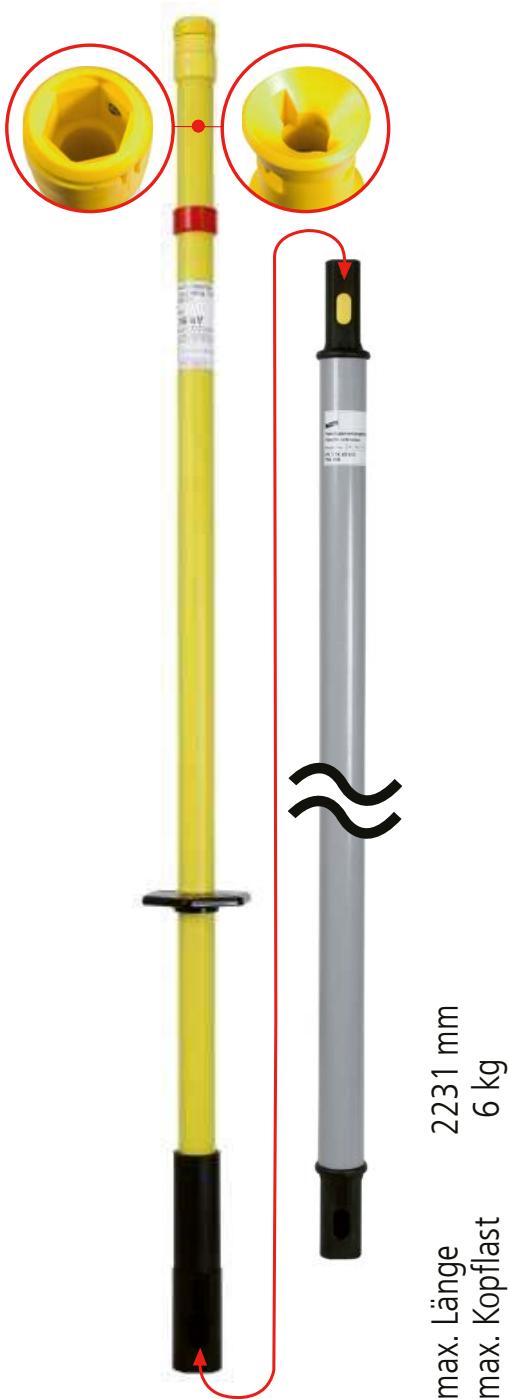

4.2 Anwendungskombinationen, Isolierstange IS 123 SQ STK 2000 als Arbeits- stange zum Einbringen von isolierenden Schutzplatten, Bauform A3, (Ausführung, Spindel mit Querstift) oder Schwenkschubplatten


Kombination A

Handhabeverlängerung HV STK 30 710 +
Isolierstange IS 123 SQ STK 2000

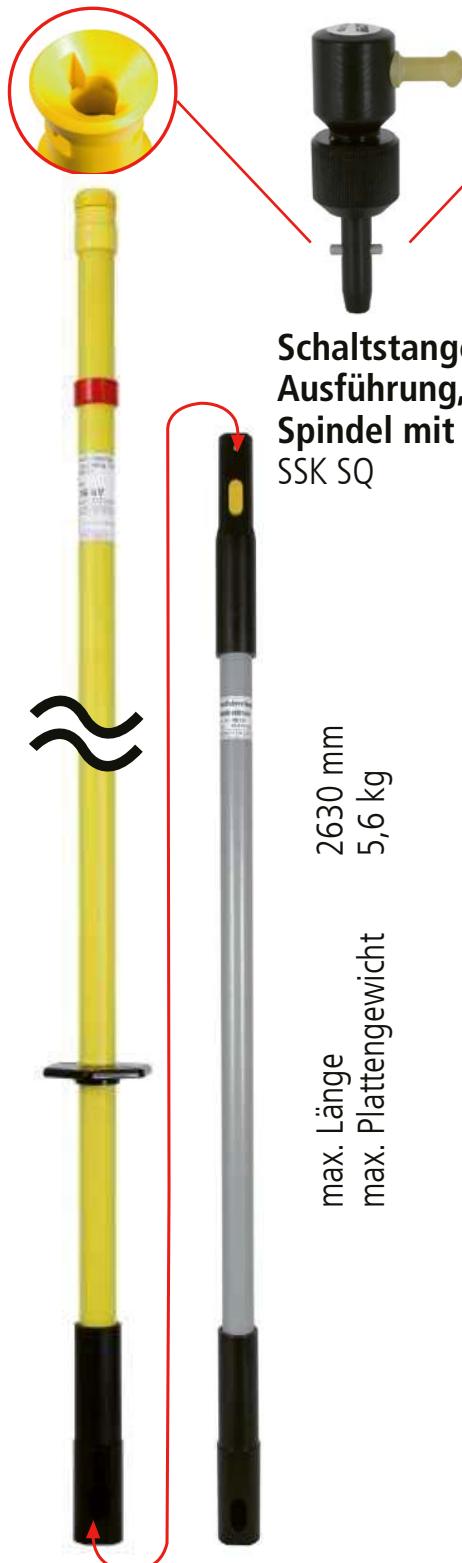

Kombination B


Handhabeverlängerung HV STK 43 910 +
Isolierstange IS 123 SQ STK 2000

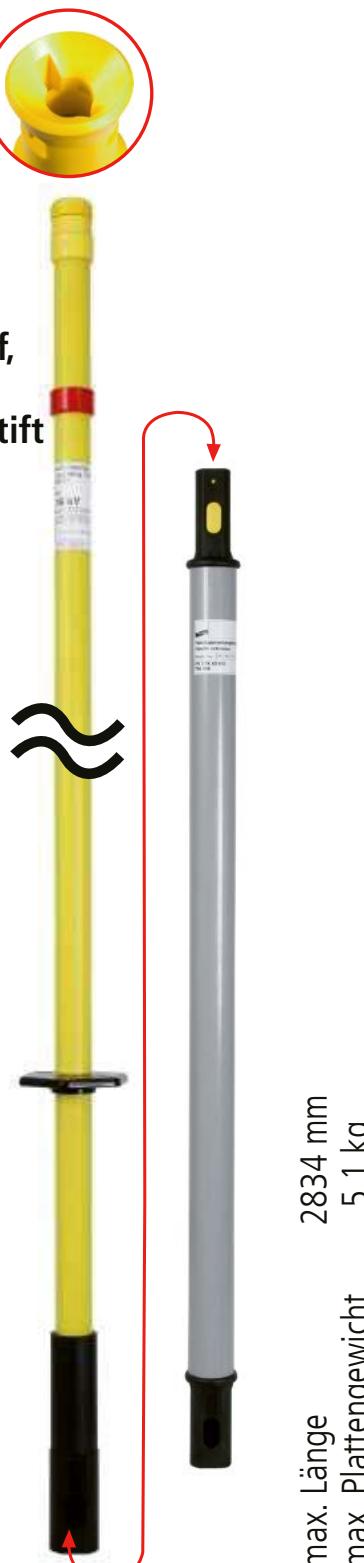

Anwendungskombinationen, Isolierstange IS 123 SQ STK 2000 als Arbeitsstange zum Einbringen von isolierenden Schutzplatten, Bauform A3, (Ausführung, Spindel mit Querstift) oder Schwenkschubplatten

Kombination C


Handhabeverlängerung HV STK 43 1280 +
Isolierstange IS 123 SQ STK 2000

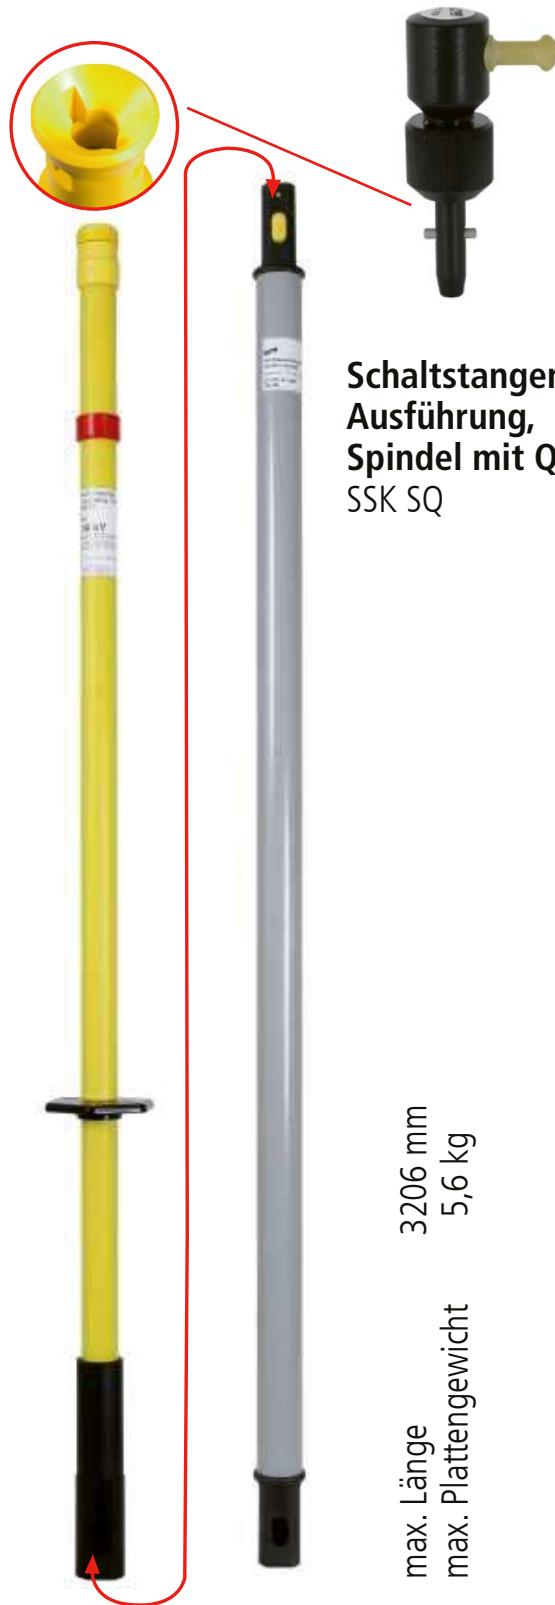

Anwendungskombinationen, Isolierstange IS ... als Schaltstange

Kombination C


Handhabeverlängerung HV STK 43 1280
+ Isolierstange IS 123 SK STK 2000 oder
Isolierstange IS 123 SQ STK 2000
+ Schaltstangenkopf SSK M12 oder SSK SQ

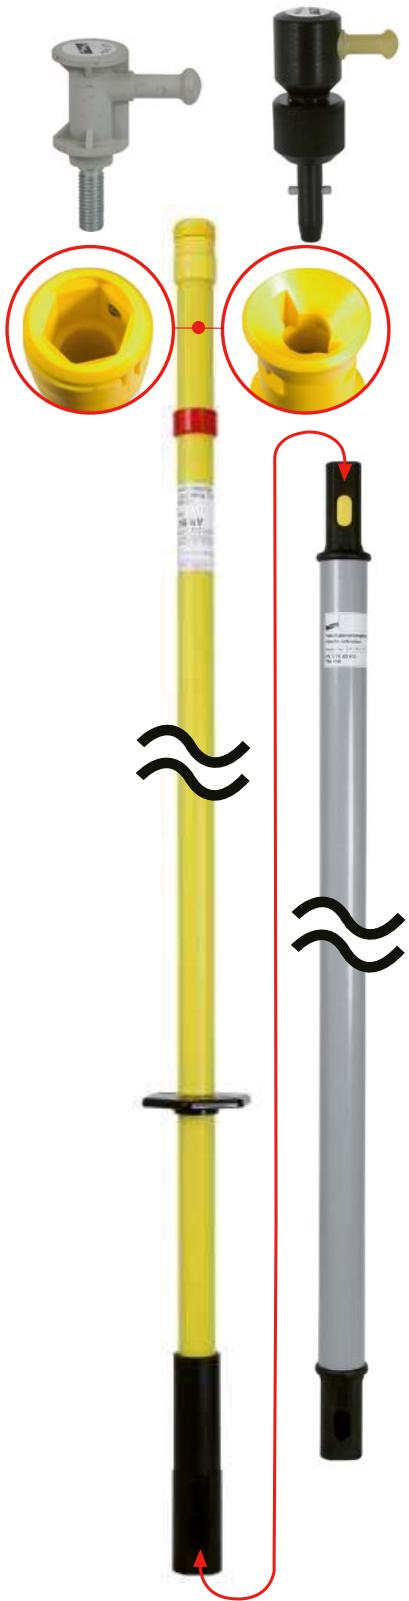

4.2.2 Anwendungskombinationen, Isolierstange IS 123 ... als Erdungsstange

Kombination A


1 x Handhabeverlängerung
HV STK 30 710
+ Isolierstange IS 123 SK STK 2000 oder
Isolierstange IS 123 SQ STK 2000

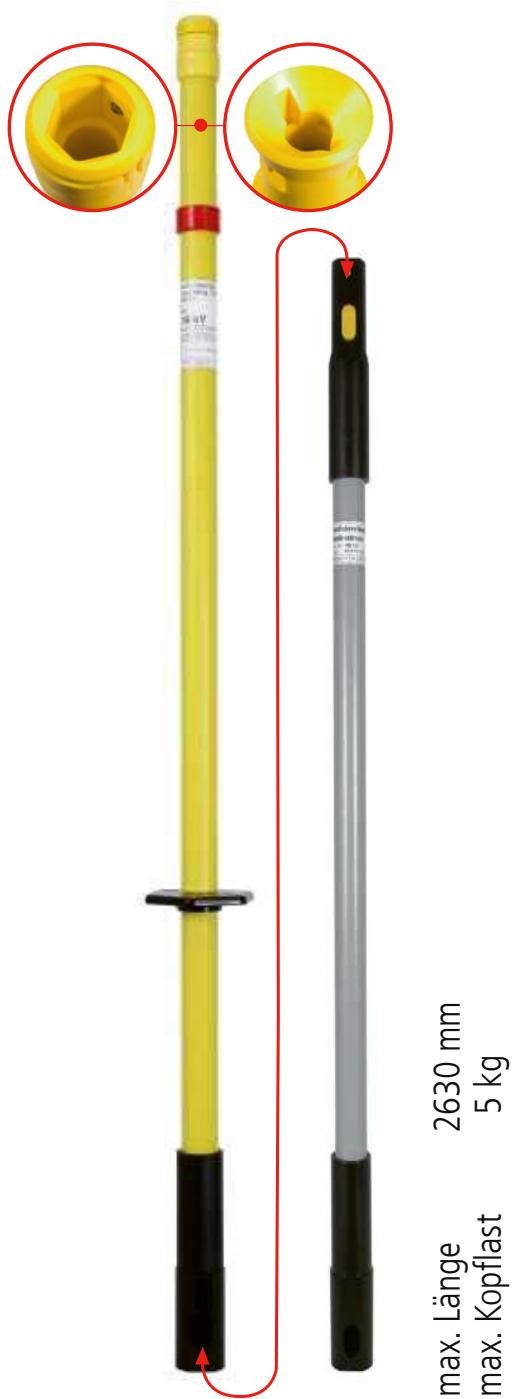

Anwendungskombinationen, Isolierstange IS 123 SK STK 2000 oder IS 123 SQ STK 2000 als Erdungsstange


Kombination B

1 x Handhabeverlängerung
HV STK 43 910
+ Isolierstange IS 123 SK STK 2000 oder
Isolierstange IS 123 SQ STK 2000

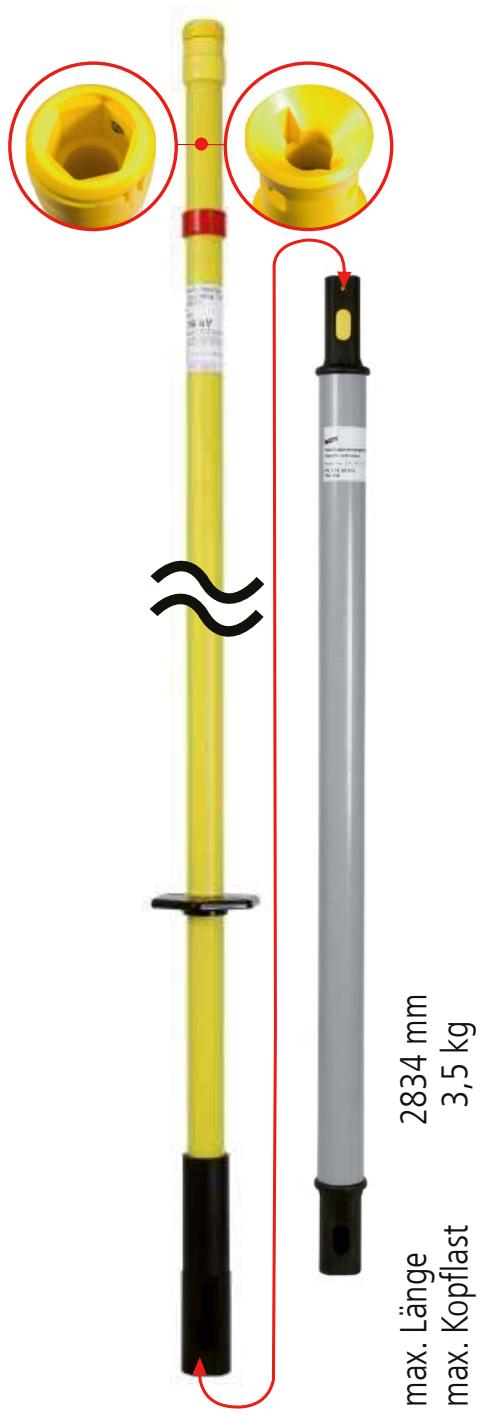

Kombination C

1 x Handhabeverlängerung
HV STK 43 1280
+ Isolierstange IS 123 SK STK 2000 oder
Isolierstange IS 123 SQ STK 2000

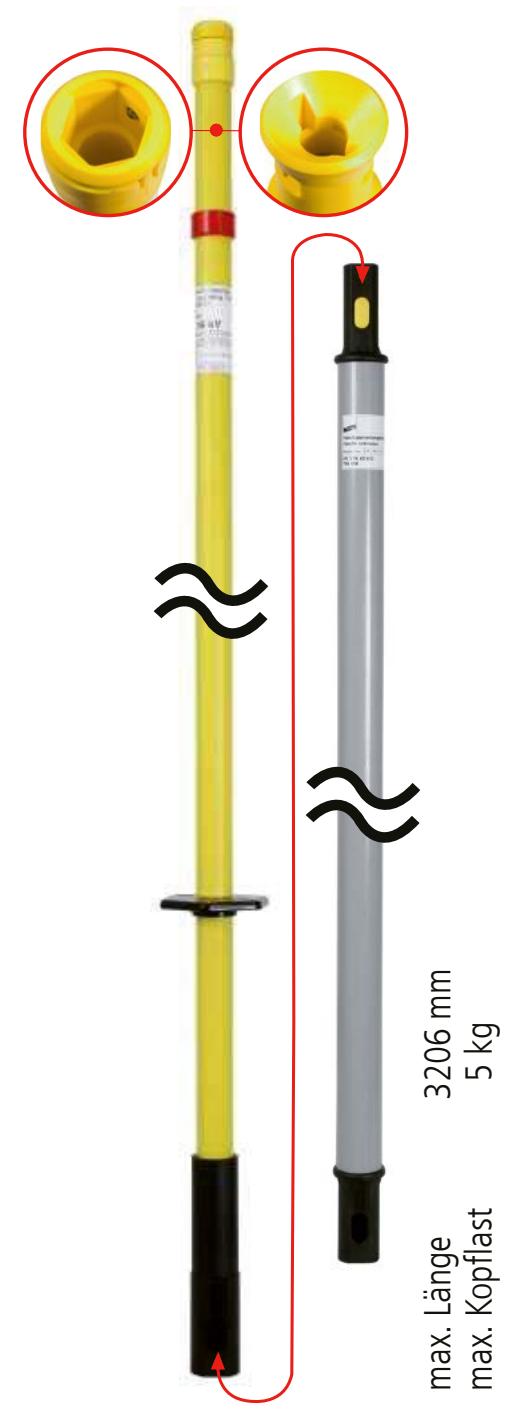

5. Wiederholungsprüfung

Für die Isolierstange IS ... wird eine Prüfung auf Ableitstrom und Überbrückungssicherheit nach DIN VDE 0681 Teil 1 in festzulegenden Zeitabständen empfohlen.

Für den Schaltstangenkopf SSK M12 und SSK SQ wird eine Prüfung auf Überbrückungssicherheit nach DIN VDE 0681 Teil 1 in festzulegenden Zeitabständen empfohlen.

Die Fristen für die Wiederholungsprüfung sind nach den Einsatzbedingungen, z.B. Häufigkeit der Benutzung, Beanspruchung durch Umgebungsbedingungen, Transport usw. festzulegen. Empfohlen wird eine Wiederholungsprüfung mindestens alle 6 Jahre durchzuführen.

6. Reinigung und Pflege

Grundsätzlich sind alle Isolierstangen IS ... und deren Zubehör pfleglich zu behandeln.

Sind Teile verschmutzt so sind sie vor und nach der Benutzung mit einem flusselfreien, feuchten Tuch (z.B. Fensterleder) zu reinigen. Bei der Reinigung der Teile dürfen nur die hier aufgeführten Reinigungs- oder Lösungsmittel verwendet werden.

Nachfolgende Reinigungsmittel sind zugelassen:

- Florin 2000 (Fa. FLORE, Koblenz)
- Rivolta, B.W.R. 210, (Bremer & Legoil GmbH, Duisburg)

Die Herstellerangaben sind zu beachten

Bei der Reinigung der Einzelteile mittels Reinigungsflüssigkeit sind entsprechende Sicherheitsmaßnahmen zu ergreifen.

Die Bestimmungen der Verordnung über brennbare Flüssigkeiten sind einzuhalten.

Dazu gehören insbesondere:

- Rauchverbot**
- Umgang mit und Lagerung von brennbaren Flüssigkeiten, usw.**

Vor der Anwendung ist durch Sichtprüfung festzustellen, ob die Reinigungsflüssigkeit an den Ausrüstungsteilen verdunstet ist.

7. Transport und Aufbewahrung

Der Transport und die Aufbewahrung der Isolierstange IS ... und deren Zubehörteile hat so zu erfolgen, dass dabei keine Minderung der Gebrauchseigenschaft eintritt.

7.1 Transport

Der Transport der Isolierstange IS ... und deren Zubehörteile sollte zweckmäßigerweise in der dafür vorgesehenen Kunstledertasche, KLT 133 34 10, Art.-Nr. 766 996 erfolgen.



7.2 Aufbewahrung

- Aufbewahrung der Ausrüstung in geschlossenen Räumen oder Fahrzeugen.
- Relative Luftfeuchtigkeit: 20 - 96%
- Lufttemperatur: -25°C - +70°C
- Keine direkte Sonneneinstrahlung

7.3 Schutz vor UV-Strahlung

Verschiedene Isolierstoffe sind empfindlich gegen Ultra-Violette-Strahlung. Isolierende Ausrüstungen sollten deshalb nicht länger als nötig direkter Sonneneinstrahlung ausgesetzt werden.

Diese Gebrauchsanleitung ist bei der jeweiligen Isolierstange IS ... aufzubewahren.

**Überspannungsschutz
Blitzschutz/Erdung
Arbeitsschutz
DEHN schützt.**

DEHN SE + Co KG

**Hans-Dehn-Str. 1
Postfach 1640
92306 Neumarkt
Germany**

**Tel. +49 9181 906-0
www.dehn.de**



Safty equipment

Instruction for use

for IS 36 ... STK ... Insulating Rods

For nominal voltages of 36 / 123 KV for use as

- Operating rod
- Switching rod
- Earthing rod

Contents

Specific safety instructions	3
1. General conditions of use	4
2. Usage notes.....	5
3. Instructions for use.....	7
3.1 Insulating rod IS 36	7
3.1.1 Insulating rod, IS 36 .. 1000 / 1500	7
3.1.2 Insulating rod, IS ... STK	8
3.1.3 Extension handles, HV	9
3.1.4 Accessory parts for IS... insulating rods	10
3.2 Use, assembly/disassembly of IS... insulating rods	11
3.2.1 Coupling,IS .. insulating rod	12
3.2.1.1 Coupling, hexagon shaft	12
3.2.1.2 Coupling, T pin shaft.....	13
3.2.1.3 AES SQ SK adapter with T pin shaft / hexagon shaft.....	14
3.2.1.4 SSK M12 and SSK SQ switching rod head	14
3.2.1.5 SSK M12 and SSK SQ switching rod head factory-assembled	15
3.2.1.6 (type-tested) systems	15
3.2.2 Sealing unit.....	15
3.2.2 Plastic plug-in coupling system, assembly/disassembly	16
4. Possible combinations.....	17
4.1 IS 36 ... STK 1000 insulating rod (with plastic plug-in coupling system)	17
4.2 IS 123 ... STK 2000 insulating rod	25
5. Maintenance test	29
6. Cleaning and care.....	29
7. Transport and storage.....	30
7.1 Transport	30
7.2 Storage.....	30
7.3 Protection against UV radiation.....	30

Specific safety instructions

Only electrically skilled or instructed persons are allowed to use the IS insulating rod in accordance with EN 50110-1: ... (DIN VDE 0150-105:...) – threat to life!

Only use the IS insulating rod if fire and explosion precautions were taken (see B2 and B3 EN 50110-1 (DIN VDE 0150-100 ...)).

The IS insulating rod and the relevant HV... extension handles have to be thoroughly examined for perfect condition before use. Do not use the IS insulating rod and the selected individual parts if damage or any other defect is discovered.

Only the combinations of the IS insulating rod described in these instructions for use are allowed.

If only one of the safety instructions is not followed accurately or is disregarded, the life and health of the user and system availability are threatened.

Modifications to the IS insulating rod and the approved operating heads and extensions or the installation of components from other manufacturers or of other types threaten occupational safety, are impermissible and invalidate the warranty.

1. General conditions of use

Observe DIN VDE 0105-100 when using the IS insulating rod.

Only use the IS insulating rod in installations which are specified on the rating plate (e.g. nominal voltage/nominal frequency).

The IS insulating rod can be converted to a switching rod by attaching a SSK SQ/SSK M12 switching rod head.

The IS insulating rod can be used as operating rod for inserting insulating protective shutters type A3.

The IS insulating rod can be used as earthing rod for attaching earthing and short-circuiting devices.

Only contact the handle of the IS insulating rod and operate it from a safe location. The user has to maintain the required safety distance from live parts of the installation.

If the IS insulating rod is used as operating rod or switching rod, it may not be used in wet weather conditions.

The requirements for the IS insulating rod are based on the reduced values of the minimum distances in accordance with DIN VDE 0101:

The IS insulating rod may therefore be used in factory-assembled, type-tested installations (in accordance with DIN VDE 0670: ...) only under certain conditions. The user or the operator of the IS 36 ... insulating rod has to contact the manufacturer of the factory-assembled, type-tested switchgear installation to find out whether and where the IS insulating rod may be used.

When using the IS insulating rod, wear appropriate personal protective equipment consisting of:

- Hard hat with face shield
- Protective gloves
- ...

Observe the specified limit values of –25 °C to +55 °C (temperature) and 20% to 96% (relative humidity) when using the IS insulating rod.

2. Usage notes

Observe the following points when using the IS 36 ... insulating rod:

- 2.1 Before assembly and use, all single parts have to be visually inspected for mechanical damage e.g. loose handguards and red ring, cracks and deep scratches, operation of the plug-in coupling.
- 2.2 For safety reasons, faulty single parts have to be refrained from further use.
- 2.3 Clean slightly soiled single parts with a clean, lint-free cloth before assembly.
- 2.4 Remove heavily soiled single parts (tough layers) using the approved cleaning agents mentioned in these instructions for use (see section 6, page 30).
- 2.5 Wipe clean bedewed, damp single parts (e.g. due to extreme temperature fluctuations) before use. If required, wait until the single parts have reached the ambient temperature.
- 2.6 When using the IS insulating rod, observe and adhere to the notes in these instructions for use.
- 2.7 Only contact the handle of the IS insulating rod.
- 2.8 The handguard and the red ring limit the insulating section rated for the nominal voltage (see Fig. 3.2, page 11 and 3.21.1, page 12).
- 2.9 The entire IS insulating rod may contact earthed parts of the installation.
- 2.10 Only the section above the red ring of the IS insulating rod may contact live parts of the installation.

- 2.11 If the IS ... insulating rod is used as switching rod or operating rod, it can be used in indoor and outdoor installations, but not in wet weather conditions (rain, fog ...). Observe the permissible shutter weight according to the total length when using the IS ... insulating rod for inserting insulating protective shutters type A3 (see possible combinations, page 18 and the following).
- 2.12 If the IS ... insulating rod is used as earthing rod, it can be used in indoor and outdoor installations in all weather conditions (rain, fog ...). Observe the permissible load on the operating head according to the total length when attaching earthing and short-circuiting devices (see possible combinations, page 18 and the following).
- 2.13 When using the IS ... insulating rod as switching, operating rod or earthing rod, the specified limit values of -25°C to $+55^{\circ}\text{C}$ (temperature) and 20% to 96% (relative humidity) have to be observed.
- 2.14 Protect the IS ... insulating rod and its accessory parts against dirt and damage during transport. It is advisable to transport and store the single parts in the appropriate transport bag (see section 7, page 31).
- 2.15 Observe a temperature range from -25°C to $+70^{\circ}\text{C}$ and the limit values for the relative air humidity of 20% to 70% when transporting and storing the IS ... insulating rod and its accessory parts.

3. Instructions for use

3.1 IS 36 ... insulating rod

3.1.1 Insulating rod, IS 36 ... 1000/1500

The IS 36 ... 1000/1500 insulating rod can be used as operating rod for inserting insulating protective shutters (DIN VDE 0682-552), as switching rod by means of attaching a switching rod head (DIN VDE 0681-1-2) and as earthing rod for attaching earthing and short-circuiting devices (see Fig. 3.1.1).

Rating plate



Rating plate



Maximum permissible shutter weight when using the IS 36 ... insulating rod as operating rod:

IS 36 ... insulating rod

IS 36 SQ 1000, shutter weight 6,6 kg ((T pin shaft)

IS 36 SQ 1500, shutter weight 5,6 kg ((T pin shaft)

Maximum permissible weight on the operating head when using the IS 36 ... insulating rod as earthing rod:

IS 36 SK 1000, Head load 12 kg (hexagon shaft)

IS 36 SK 1500, Head load 9 kg (hexagon shaft)

IS 36 SQ 1000, Head load 12 kg (T pin shaft)

IS 36 SQ 1500, Head load 9 kg (T pin shaft)


IS 36 SQ ...

T pin shaft




IS 36 SK ...

hexagon shaft

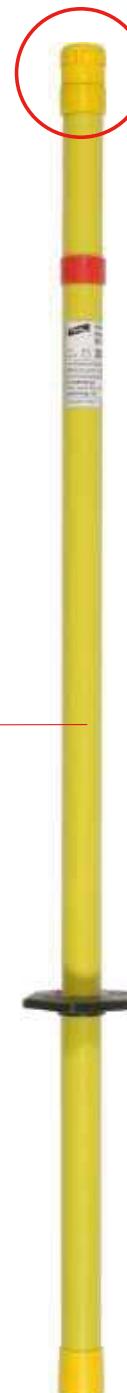

Type coding for IS 36 ... insulating rod

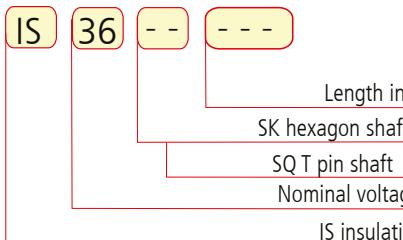

3.1.2 Insulating rod, IS ... STK

The IS ... STK ... insulating rod can be used as operating rod for inserting insulating protective shutters (DIN VDE 0682-552), as switching rod by means of attaching a switching rod head (DIN VDE 0681-1-2) and as earthing rod for attaching earthing and short-circuiting devices.

The IS STK ... insulating rod is fitted with a plastic plug-in coupling at the lower end of the handle for handle extension! The plastic plug-in coupling system allows the user to extend the handle individually. For possible combinations as well as the maximum permissible total lengths, please refer to "Possible combinations", page 18 and the following!

IS 36 SQ STK 1000,
IS 123 SQ STK 2000
T pin shaft



IS 36 SK STK 1000
IS 123 SK STK 2000
hexagon shaft




Type coding for IS 36 ... insulating rod

Rating plate

DEHN		
Isolierstange Insulating rod		
bis / up to 36 kV AC		
Bei Niederschlägen nicht verwenden! Not to be used under wet conditions!		
Gebrauchsanleitung 1708 beachten! Observe relevant instructions for use 1708!		
Zulässiges maximales Plattendgewicht siehe Gebrauchsanweisung! See instructions for use for max. permissible shutter weight!		
Mit Schaltstangenkopf Typ SSK SQ Schaltstange With Switching rod head typ SSK SQ Switching rod		
F.-Nr. Jahr Letzte Wiederh.-Prüfung Prod.-Nr. Year Last repeat test		
IS 36 SQ STK 1000 766 301		

Rating plate

DEHN		
Isolierstange Insulating rod		
bis / up to 123 kV/AC		
Mit Schaltstangenkopf Typ SSK SQ Schaltstange With Switching rod head typ SSK SQ Switching rod		
Zulässiges max. Plattendgewicht siehe Gebrauchsanleitung! See instructions for use for max. permissible shutter weight!		
Bei Niederschlägen nicht verwenden! Do not use under wet conditions!		
Gebrauchsanleitung 1708 beachten! Observe the instructions 1708!		
F.-Nr. Jahr Letzte Wiederh.-Prüfung Prod.-Nr. Year Last repeat test		
IS 123 SQ STK 2000 766 322		

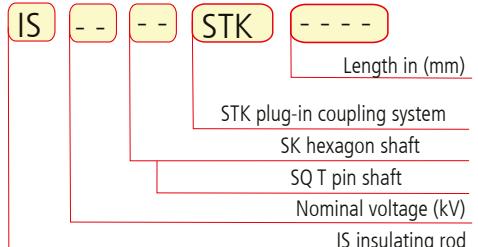

Maximum permissible shutter weight in kg, when using the IS ... insulating rod as operating rod:

IS ... insulating rod

IS 36 SQ STK 1000, shutter weight 6,6 kg (T pin shaft)

IS 123 SQ STK 2000, shutter weight 4,6 kg (T pin shaft)

Maximum permissible weight on the operating head in kg, when using the IS ... insulating rod as earthing rod:

IS 36 ... insulating rod

IS 36 SK STK 1000, 12 kg (hexagon shaft)

IS 36 SQ STK 1000, 12 kg (T pin shaft)

IS 123 SK STK 2000, 4 kg (hexagon shaft)


IS 123 SQ STK 2000, 4 kg (T pin shaft)

Fig. 3.1.2

3.1.3 HV STK ... extension handles

The following HV STK ... extension handles are available for extending the IS ... STK ... insulating rod. Only the combinations approved by DEHN are permitted (see "Possible combinations", page 18 and the following).

Type coding:

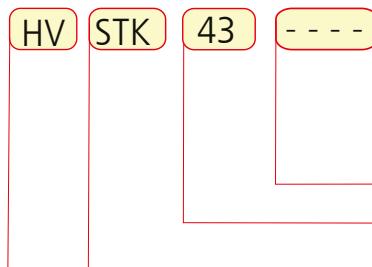

HV extension handle

	Handhabeverlängerung Handle extensions
	Gebrauchsanleitung beachten! Observe relevant instruction for use!
Baujahr/Year	09 10 11 12 13 14
HV STK 30 710	766 335

	Handhabeverlängerung Handle extensions
	Gebrauchsanleitung beachten! Observe relevant instructions for use!
Baujahr/Year	09 10 11 12 13 14
HV STK 43 910	766 456

	Handhabeverlängerung Handle extensions
	Gebrauchsanleitung beachten! Observe relevant instructions for use!
Baujahr/Year	09 10 11 12 13 14
HV STK 43	1280

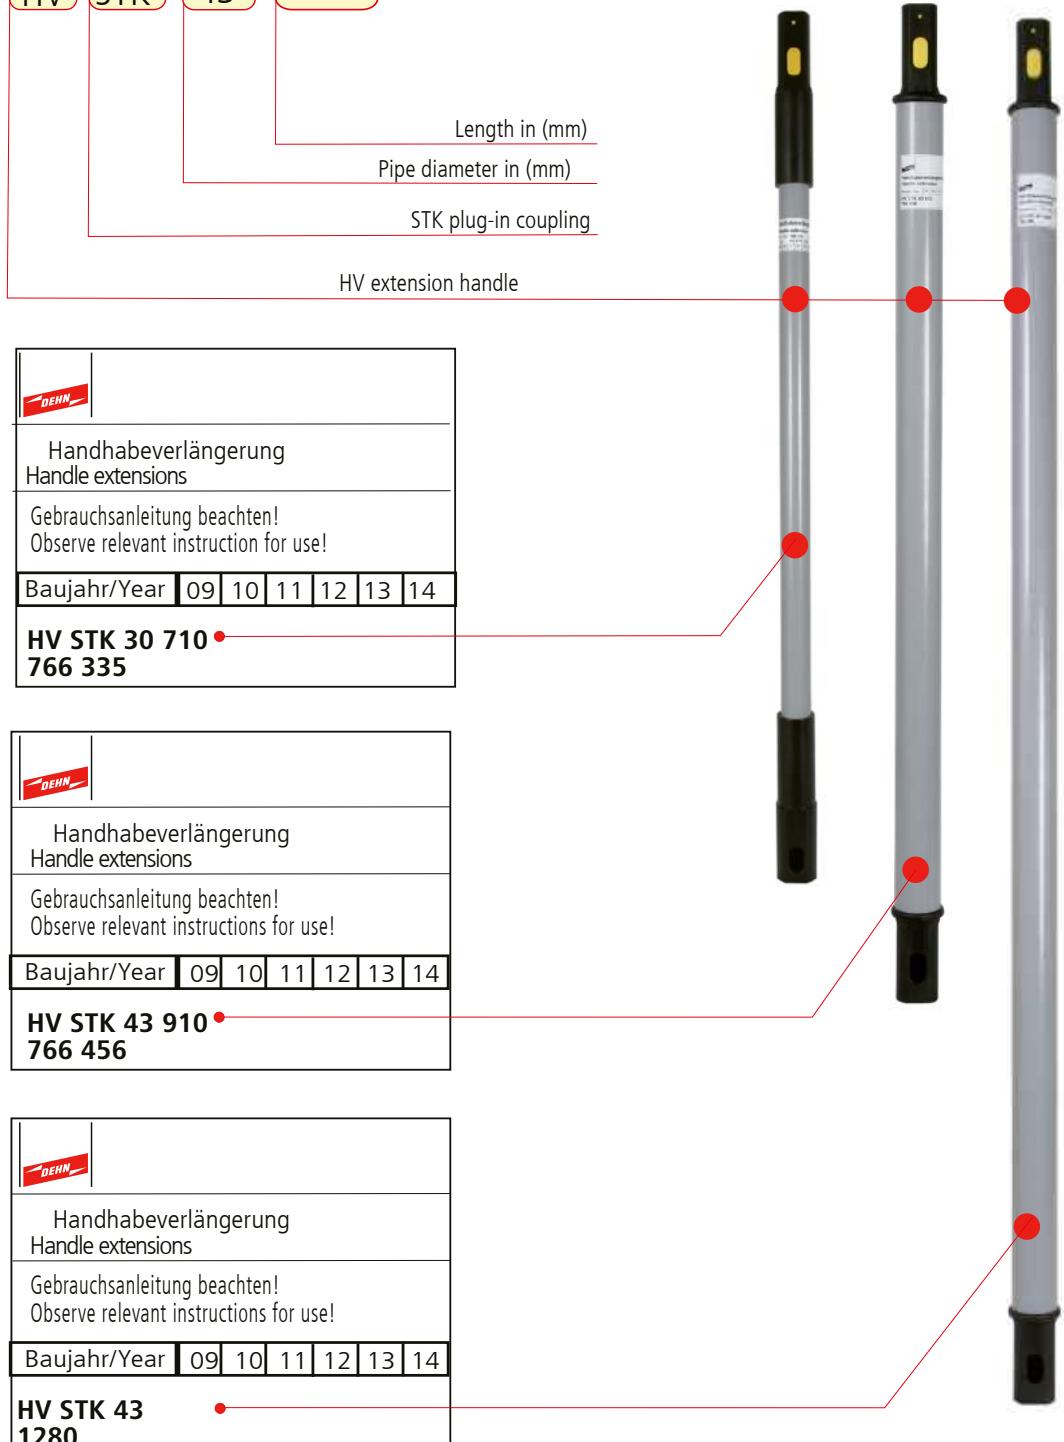


Fig. 3.1.3

3.1.4 Accessory parts for IS ... insulating rods

The following accessory parts can be used individually in combination with IS ... insulating rods.

**Switching rod head
with M12 thread**
SSK M12



Type coding:
SSK M12
 M12 thread
 SSK switching rod head

**Switching rod head
with T pin shaft**
SSK SQ



Type coding:
SSK SQ
 SQ T pin shaft
 SSK switching rod head

Sealing unit
AR STK



Note:
 It is advisable to use the A STK sealing unit as mechanical protection for the plastic plug-in coupling at the end of the handle and at the end of the HV... extension handle.

Artificial leather bag
KLT 133 34 10



Storage devices

HV P ST D30
(for rod diameters of
30 mm)

or
HV P ST D40 45
(for rod diameters of
40 to 45 mm)



3.2 Use and operation, assembly/disassembly of IS ... insulating rods

The IS ... insulating rod can be used as operating rod, switching rod or earthing rod:


- As operating rod for inserting insulating protective shutters in accordance with DIN VDE 0682 Part 552 (see page 17 and the following).
- As switching rod in accordance with DIN VDE 0681-1-2 for actuating switch disconnectors and earthing switches (see Page 17 and the following).
- As earthing rod for moving the connecting parts of earthing and short-circuiting devices close to electrical power installations for the purpose of earthing and short-circuiting (see page 17 and the following).

The IS... insulating rod consists of a coupling ①, red ring ②, insulating section ③ , handguard ④ handle ⑤ and sealing unit ⑥(see Fig. 3.2)

If the IS ... insulating rod is used as operating rod or earthing rod, it has to be selected according to the weight of the protective shutters or earthing and short-circuiting device (shutter weight / load on the operating head in kg), see "Possible combinations", section 4, page 17.

Only contact the handle ⑤ of the IS ... insulating rod (do not contact the section beyond the handguard). ④

The handguard ④ and the red ring ② limit the insulating section ③ rated for the nominal voltage (see Fig. 3.2).

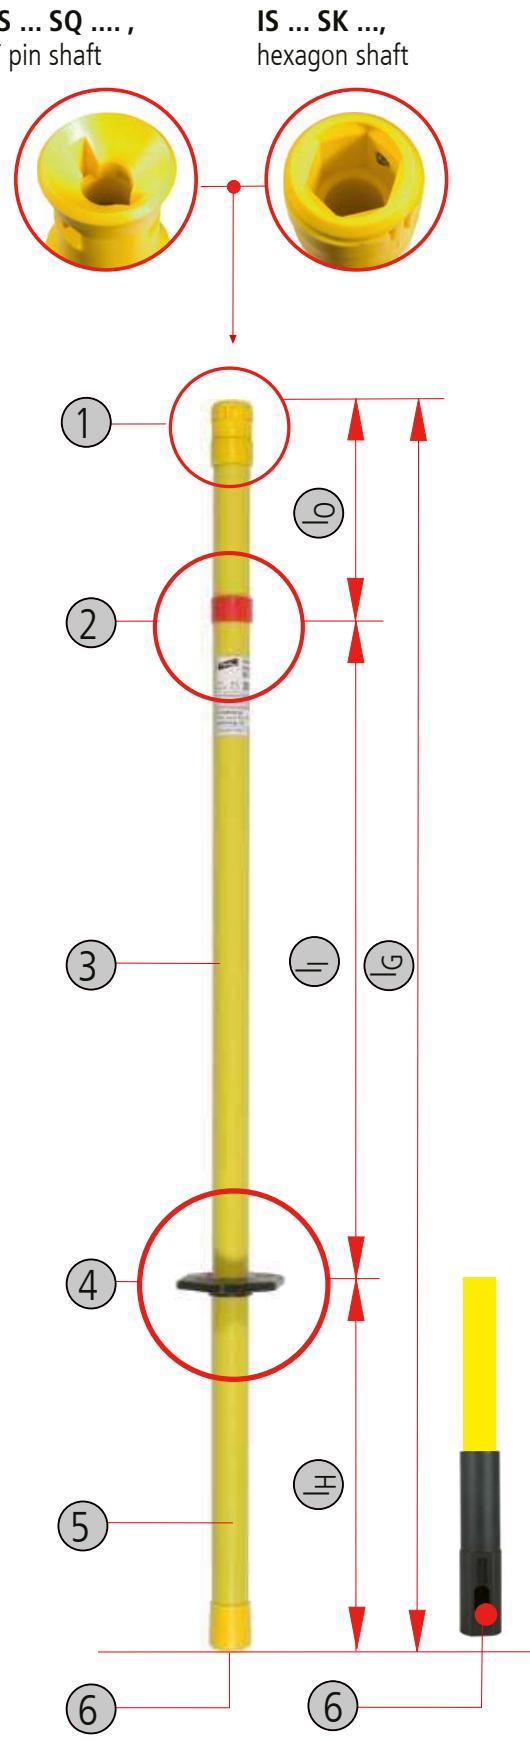

- | | | | | | |
|------------|------------|----------------------|-------------|----------|----------------|
| ① Coupling | ② Red ring | ③ Insulating section | ④ Handguard | ⑤ Handle | ⑥ Sealing unit |
|------------|------------|----------------------|-------------|----------|----------------|

- | | |
|---|--|
| l_0 | Length of the top section
(insertion depth) |
| l_I | Length of the insulating
section |
| l_H | Handle length |
| l_G | Total length |
| Sealing unit :
Plastic plug-in
coupling | |

Fig. 3.2.a

3.2.1 Coupling, IS ... insulating rod

3.2.1.1 Coupling, hexagon shaft (yellow plastic plug-in coupling)

The plug-in coupling (hexagon shaft) allows easy assembly and disassembly of the connecting part.

If connecting parts with hexagon head bolt are used, the connecting part is only held by the spring force of the coupling. Ensure tight fit (see Fig. 3.2.1.1)!

The coupling (hexagon shaft) allows for screwing the SSK M12 switching rod head onto the insulating rod. Before using the IS... insulating rod, check the SSK M12 switching rod head for tight fit (see Fig. 3.2.1.1).

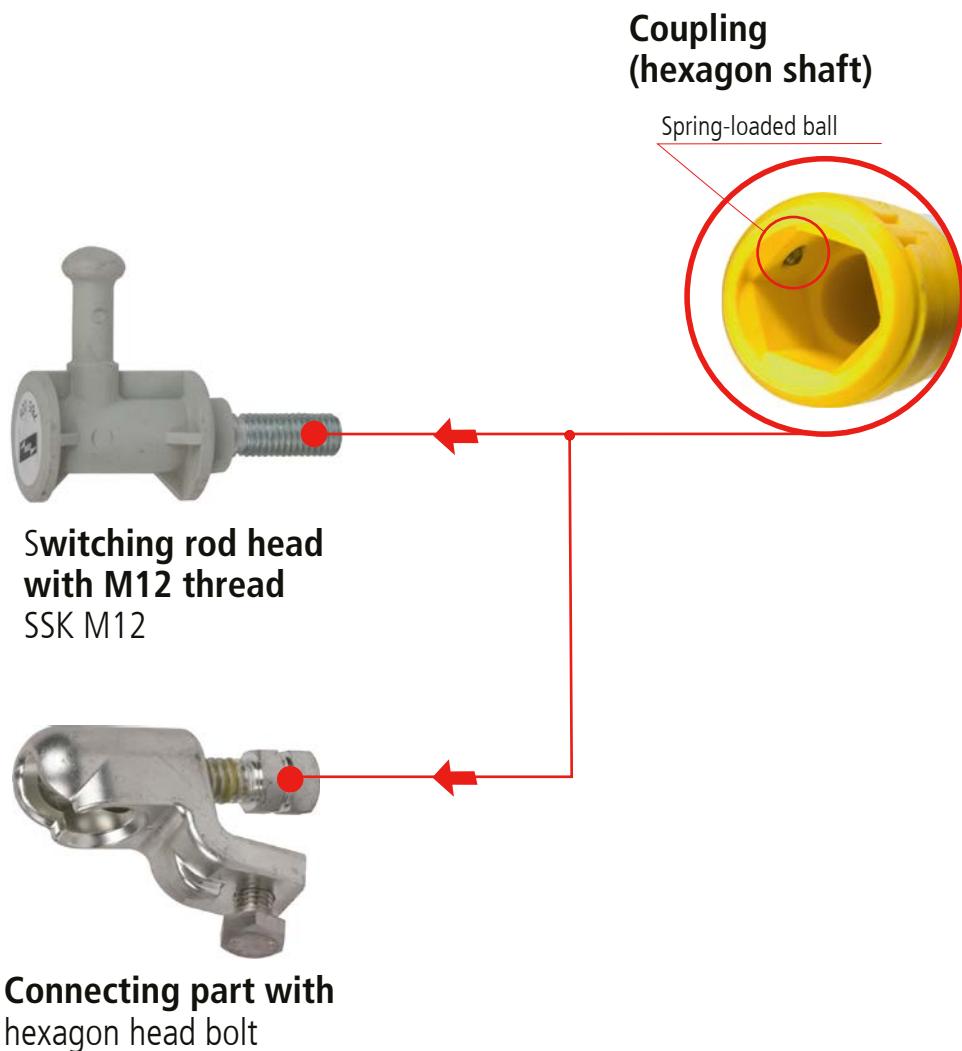


Fig. 3.2.1.1

3.2.1.2 T pin shaft coupling for indoor installations (yellow plastic coupling for short shaft)

For attaching / contacting and removing the connecting part to/from the protective shutter or to/from the earthing and short-circuiting device, the IS... insulating rod has to be pushed / turned (see Fig. 3.2.1.2).

Attachment/contacting of the connecting part (shaft, protective shutter type A3)

Insert the shaft into the coupling as far as it will go.

As soon as the shaft is inserted into the coupling as far as possible, turn the IS... insulating rod by 90° to the left. The connecting part (shaft, protective shutter type A3) of the protective shutter, switching rod head or earthing and short-circuiting device is firmly locked into the coupling.


Removal of the connecting part (shaft)

To remove/loosen the connecting part (shaft), the IS... insulating rod has to be pushed/turned/pulled.

As soon as the stop is reached, turn the IS... insulating rod by 90° to the right and pull it off.

	Assembly
	Removal

	Push/ turn
	Push/turn/pull

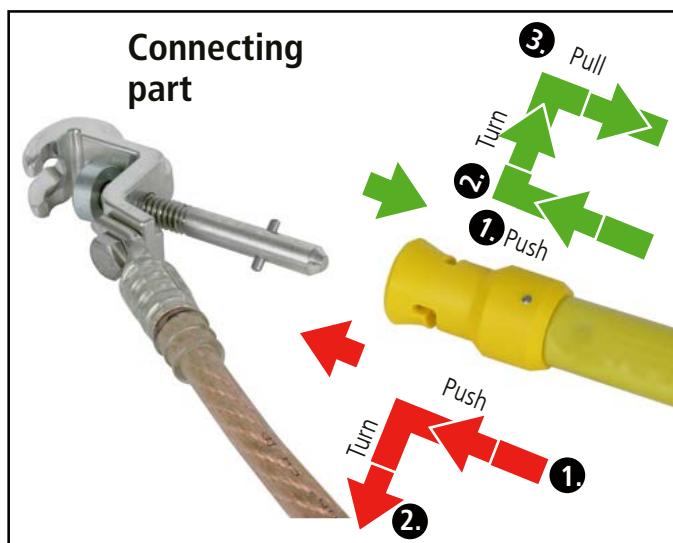

T pin shaft coupling

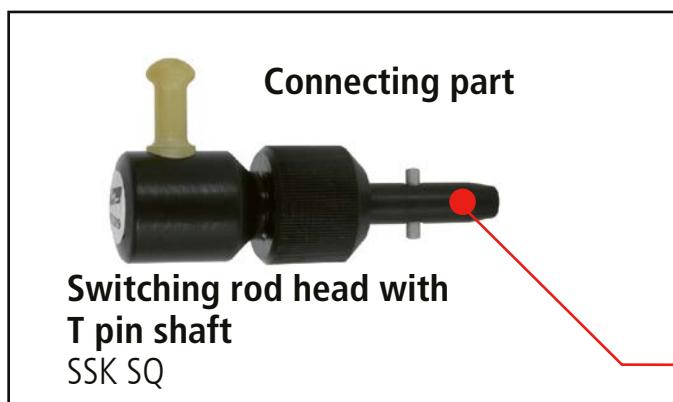


Fig. 3.2.1.2

3.2.1.3 Adapter, T pin shaft / hexagon shaft

The IS 36 SQ ... insulating rod with T pin shaft coupling can be used for connecting parts with hexagon shaft by means of attaching the AES SQ SK adapter (see Fig. 3.2.1.3).

The AES SQ SK adapter can be used for the following IS... insulating rods (T pin shaft):
IS ... insulating rod, T pin shaft, type:

- IS 36 SQ 1000
- IS 36 SQ 1500
- IS 36 SQ STK 1000
- IS 123 SQ STK 2000

Attention:

The AES SQ SK adapter is fitted with a plastic knurled nut. ①

After inserting the adapter into the T pin shaft coupling, the adapter has to be firmly tightened by means of the plastic knurled nut (see Fig. 3.2.1.3)!

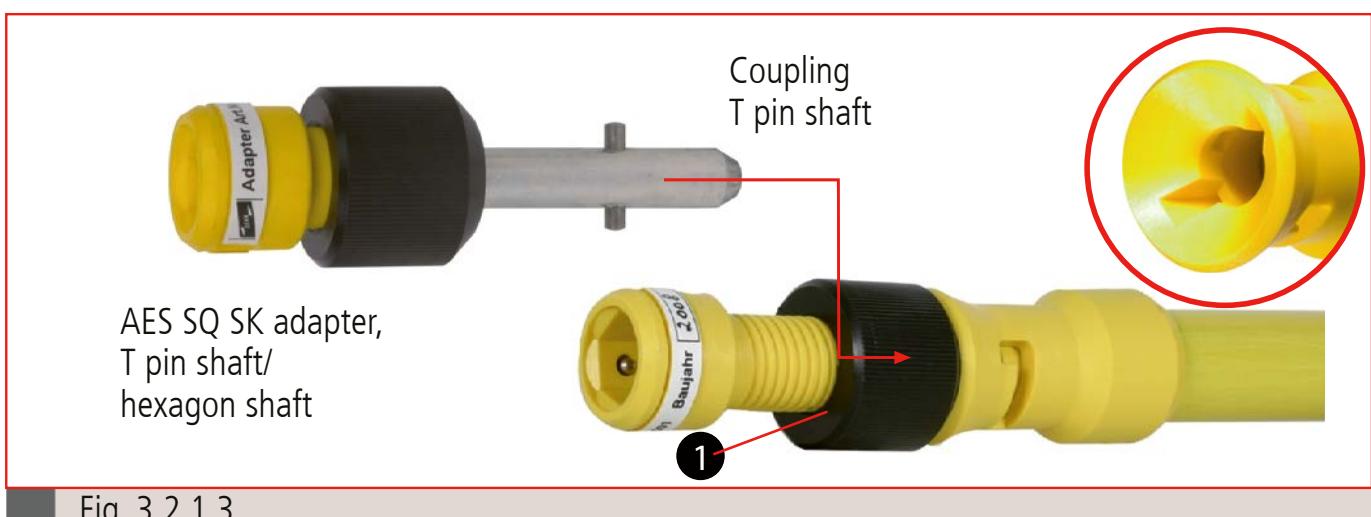


Fig. 3.2.1.3

3.2.1.4

SSK SQ switching rod head

The IS ... SQ ... insulating rod can be converted to a switching rod by means of inserting the SSK SQ switching rod head (T pin shaft) into the coupling!

Attention:

The SSK SQ switching rod head is fitted with a plastic knurled nut. ①

After inserting the switching rod head into the T pin shaft coupling, the SSK SQ switching rod head has to be firmly tightened by means of the plastic knurled nut (Fig. 3.2.1.4)!

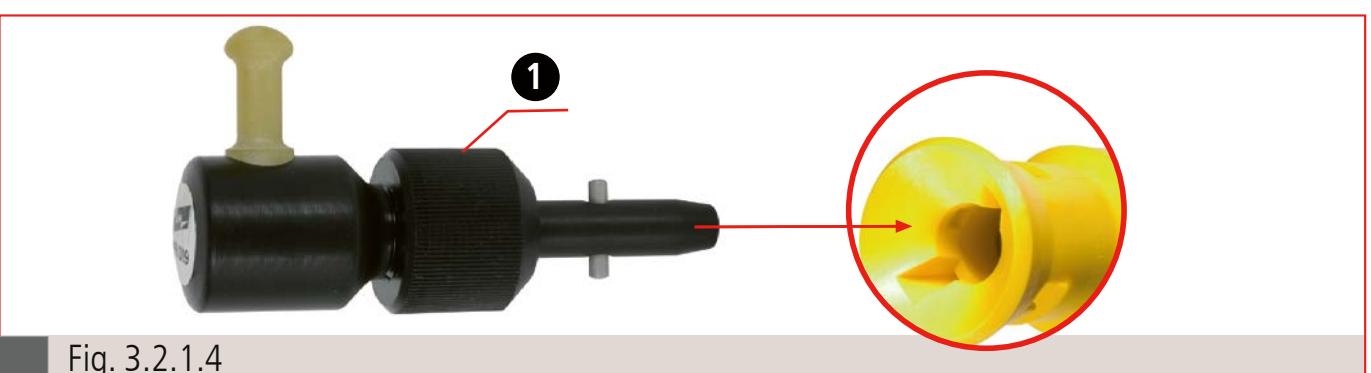


Fig. 3.2.1.4

3.2.1.5 SSK M12 and SSK SQ switching rod head for use in factory-assembled (type-tested) systems

If the SSK ... switching rod head is screwed/attached to the IS ... insulating rod, the insulating rod may only be used in factory-assembled (type-tested) installations under certain conditions! The user or the operator of the IS ... insulating rod has to contact the manufacturer of the factory-assembled, type-tested switchgear installation to find out whether and where the IS ... insulating rod with attached SSK ... switching rod head may be used (see Fig. 3.2.1.5).

Switching rod head,
with M12 thread
SSK M12



Switching rod head,
T pin shaft
SSK SQ



Fig. 3.2.1.5

3.2.1.6 Sealing unit

The A STK sealing unit is used as mechanical protection for the plastic plug-in coupling at the end of the handle of the IS ... insulating rod and at the end of the HV ... extension handle (see Fig. 3.2.1.5).



A STK sealing unit



IS ... insulating rod, HV ... extension handle

Fig. 3.2.1.6

3.2.2 Plug-in coupling system for extending the handle of IS ... STK ... insulating rods

Assembly and disassembly of extension handles and sealing units

Assembly of the extension handle, sealing unit

The IS ... insulating rod and the HV ... extension handle are fitted with a plastic plug-in coupling system, which also allows the combination of different rod diameters. Press the pushbutton at the extension handle or sealing unit for assembly. Now both coupling parts can be easily plugged together. If the coupling parts are positioned correctly, the yellow pushbutton has to snap into the long hole of the bush. Check the assembled plastic plug-in coupling for tight fit before use (see Fig. 3.2.2).

Disassembly of the extension handle, sealing unit

Press down the yellow pushbutton to release the plug-in coupling and pull apart the coupling parts.

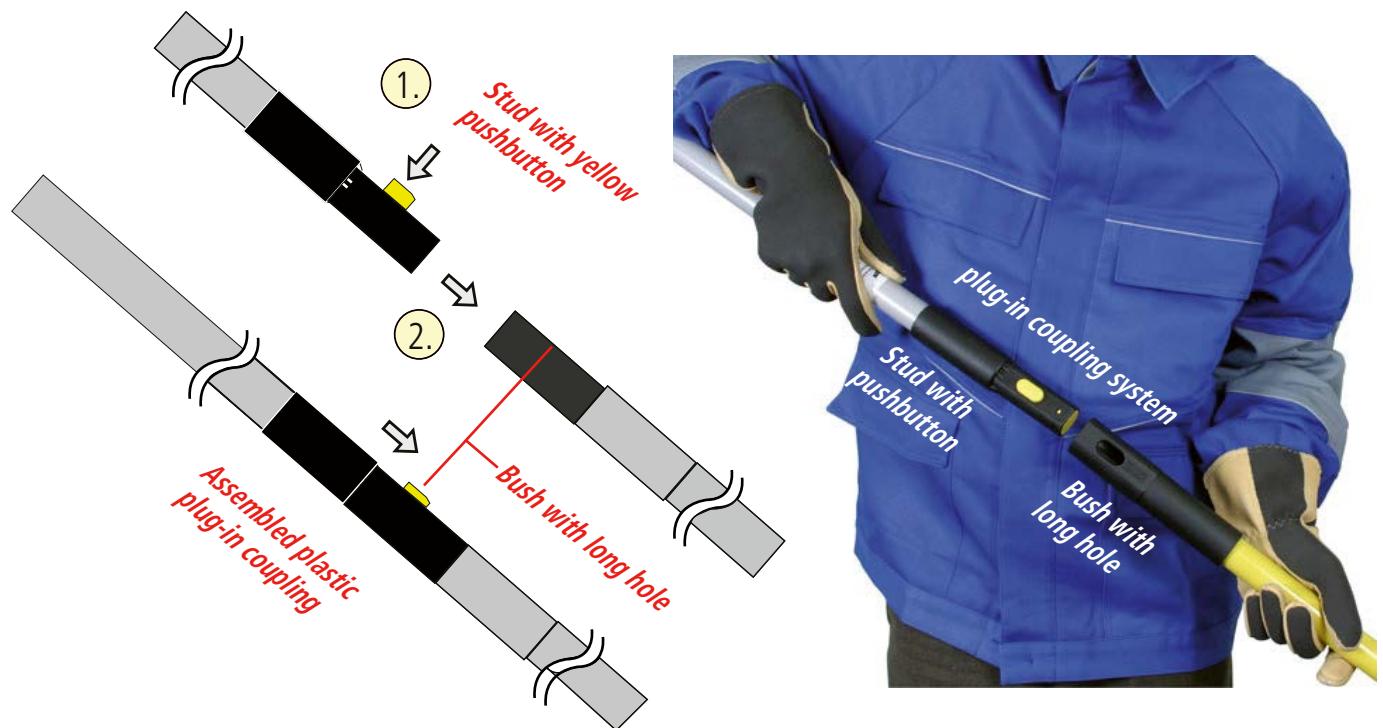


Fig. 3.2.2

4. Possible combinations

4.1 IS 36 ..., IS 36 SK STK 1000, IS 36 SQ STK 1000 insulating rod

The IS 36 ... STK 1000 insulating rod with plastic plug-in coupling as sealing unit for handle extension is available in two types for the insertion of connecting parts with hexagon or T pin shaft (see Fig. 4.1 as well as pages 18-24 "Possible combinations").


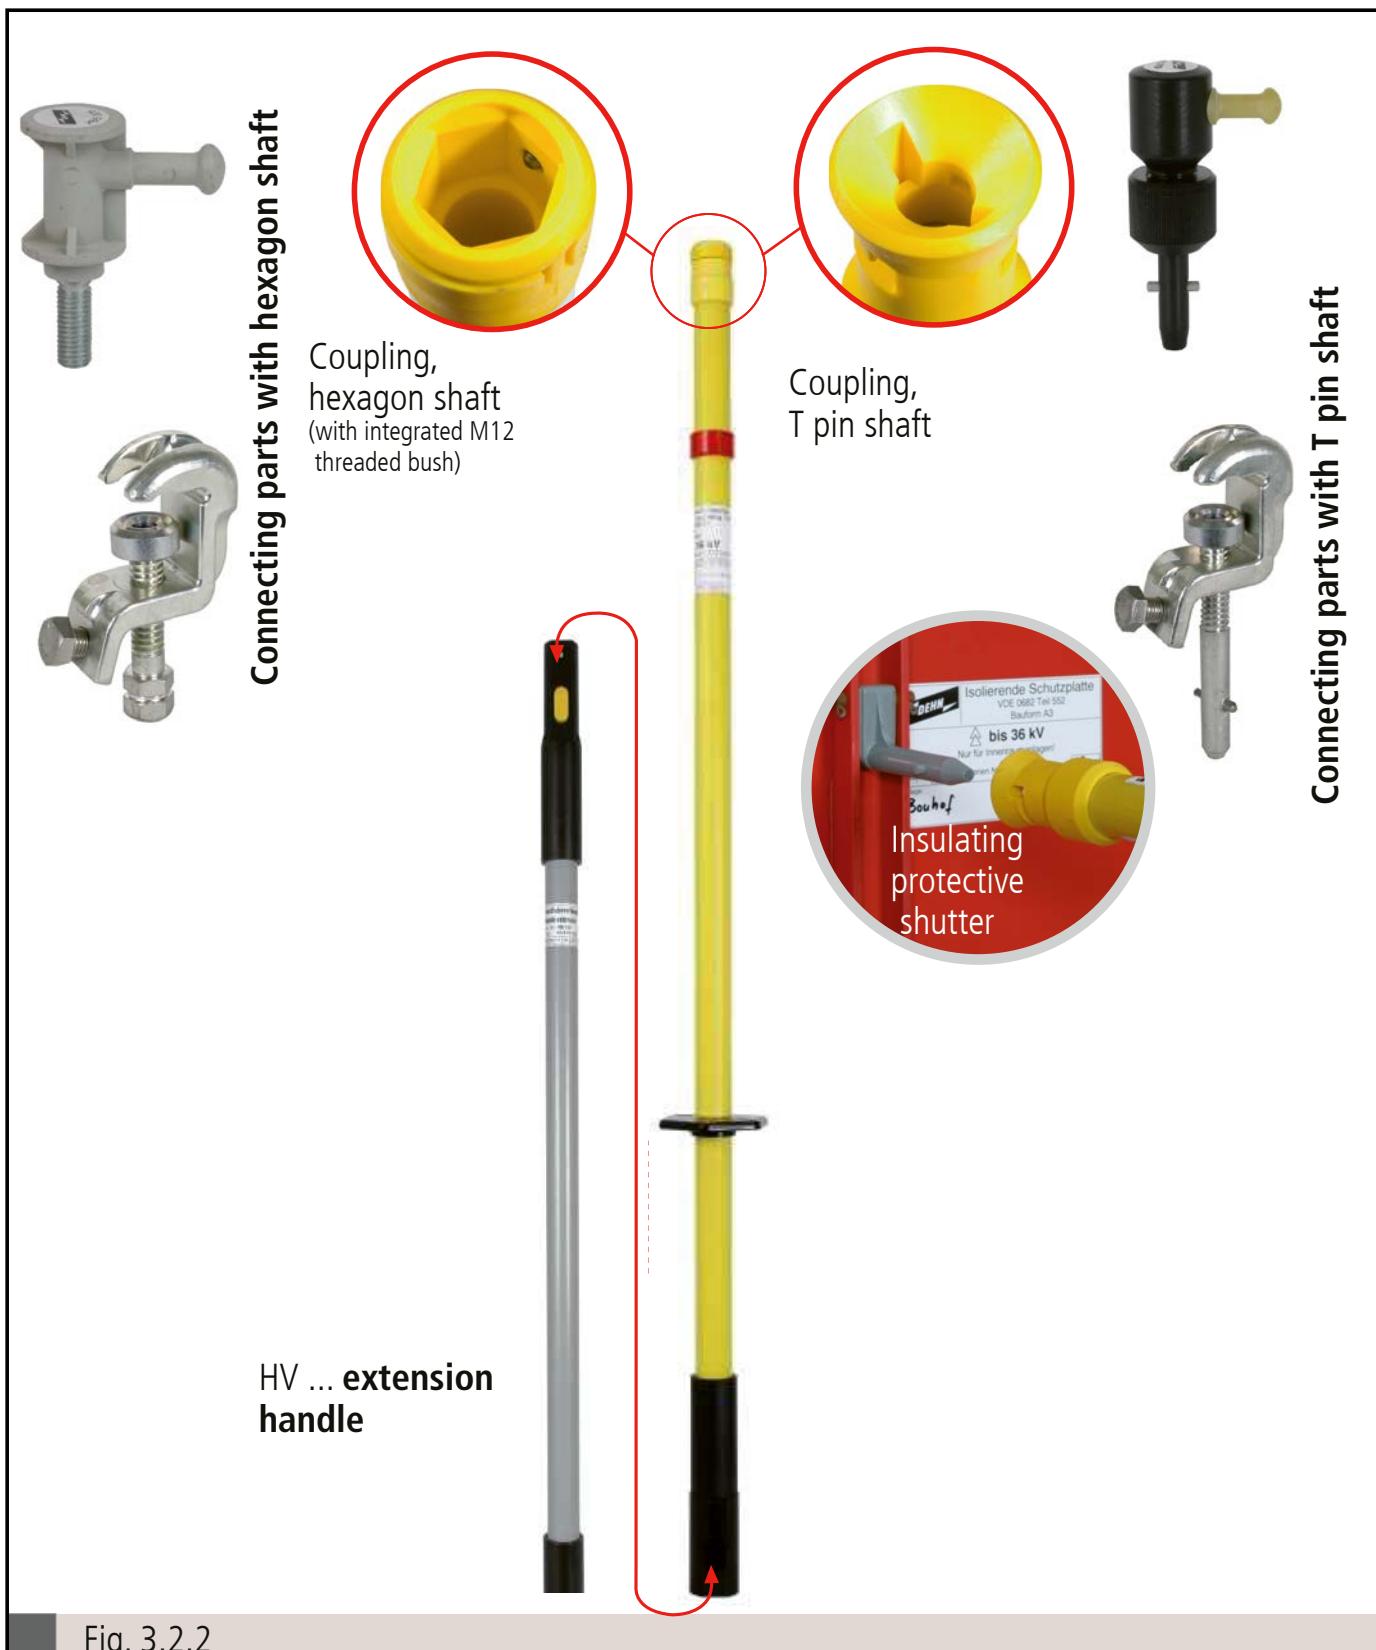


Fig. 3.2.2

4.1.1 Possible combinations, IS ... insulating rod used as operating rod for inserting insulating protective shutters type A3 (T pin shaft) or rotatable shutters


Combination A

HV STK 30 710 extension handle +
IS 36 SQ STK 1000 insulating rod

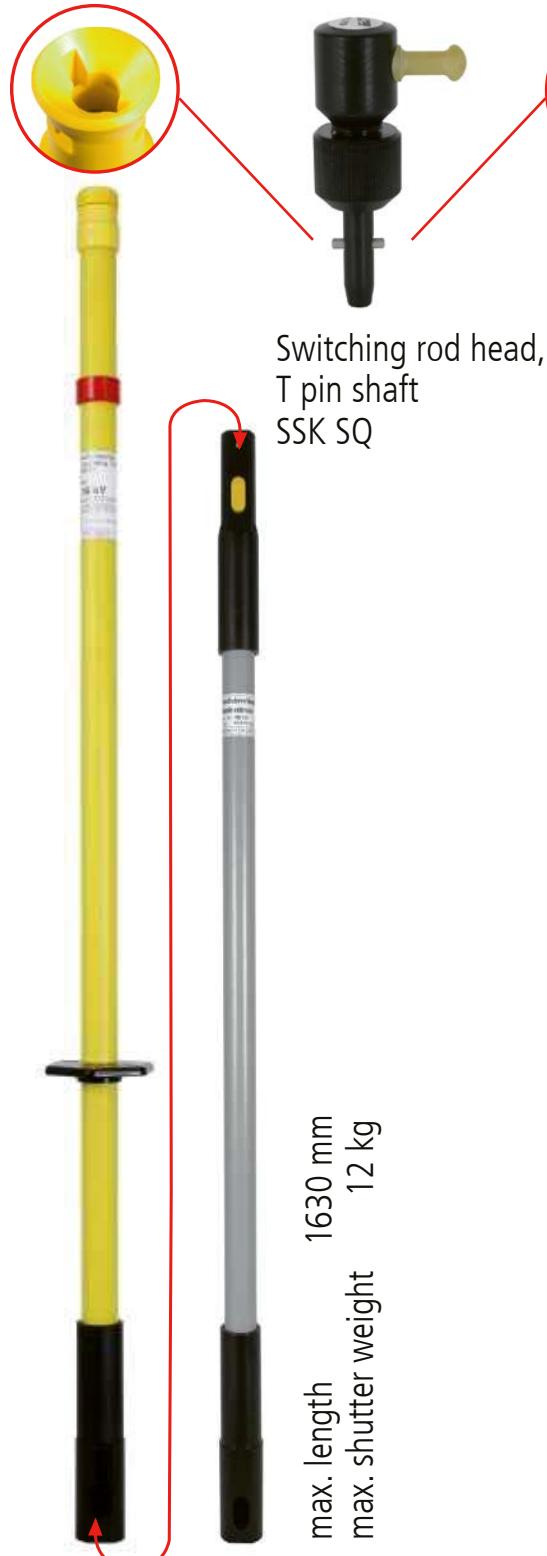

Combination B

2 HV STK 30 710 extension handles +
IS 36 SQ STK 1000 insulating rod

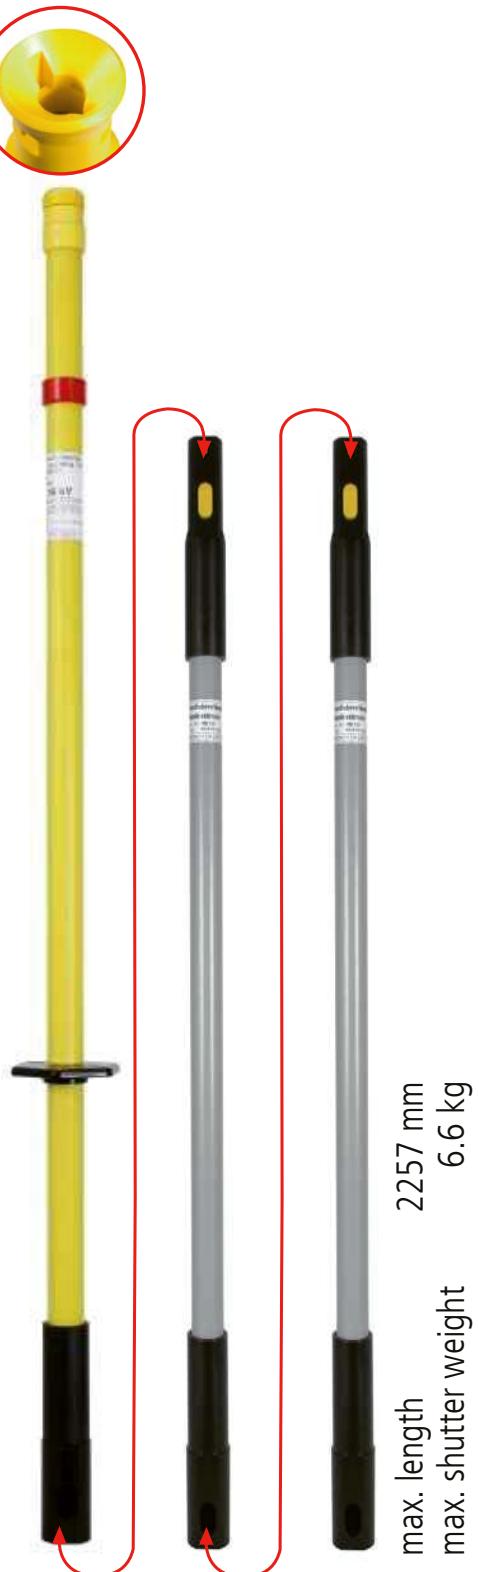


max. length
1630 mm
max. shutter weight
12 kg

max. length
2257 mm
max. shutter weight
6.6 kg

Possible combinations, IS ... insulating rod used as operating rod for inserting insulating protective shutters, type A3 (T pin shaft) or rotatable shutters

Combination C

HV STK 43 910 extension handle +
IS 36 SQ STK 1000 insulating rod

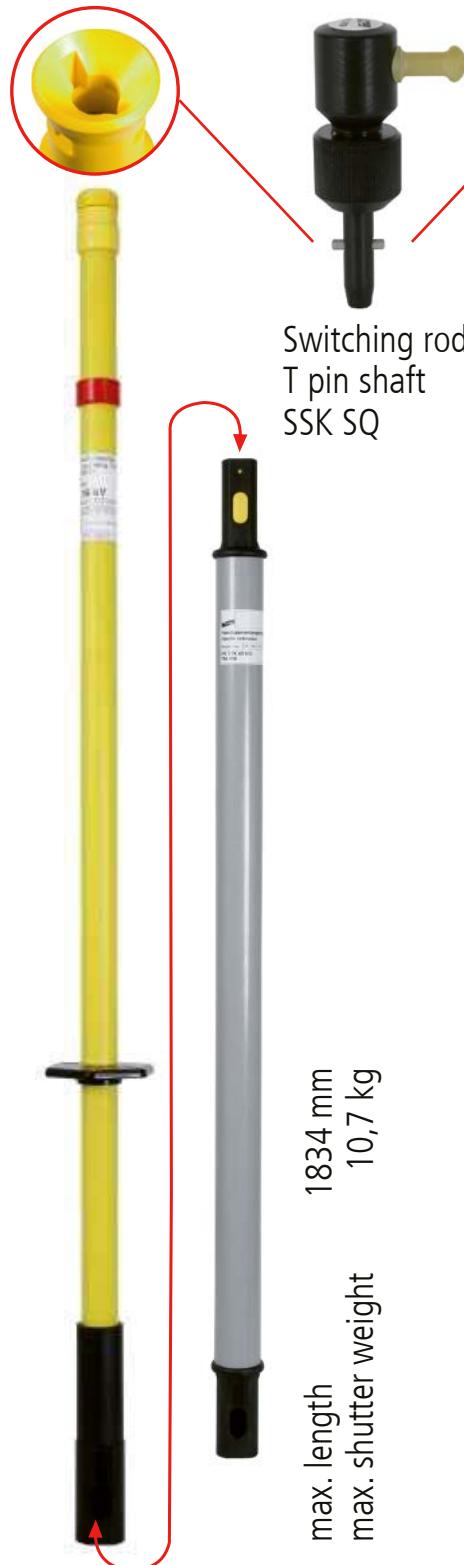

Combination D

2 HV STK 43 910 extension handles +
insulating rod IS 36 SQ STK 1000



max. length
max. shutter weight

1834 mm
10,7 kg


max. length
max. shutter weight

2692 mm
7,1 kg

Possible combinations, IS ... insulating rod used as operating rod for inserting insulating protective shutters type A3 (T pin shaft) or rotatable shutters

Combination E


HV STK 43 1280 extension handle +
IS 36 SQ STK 1000 insulating rod

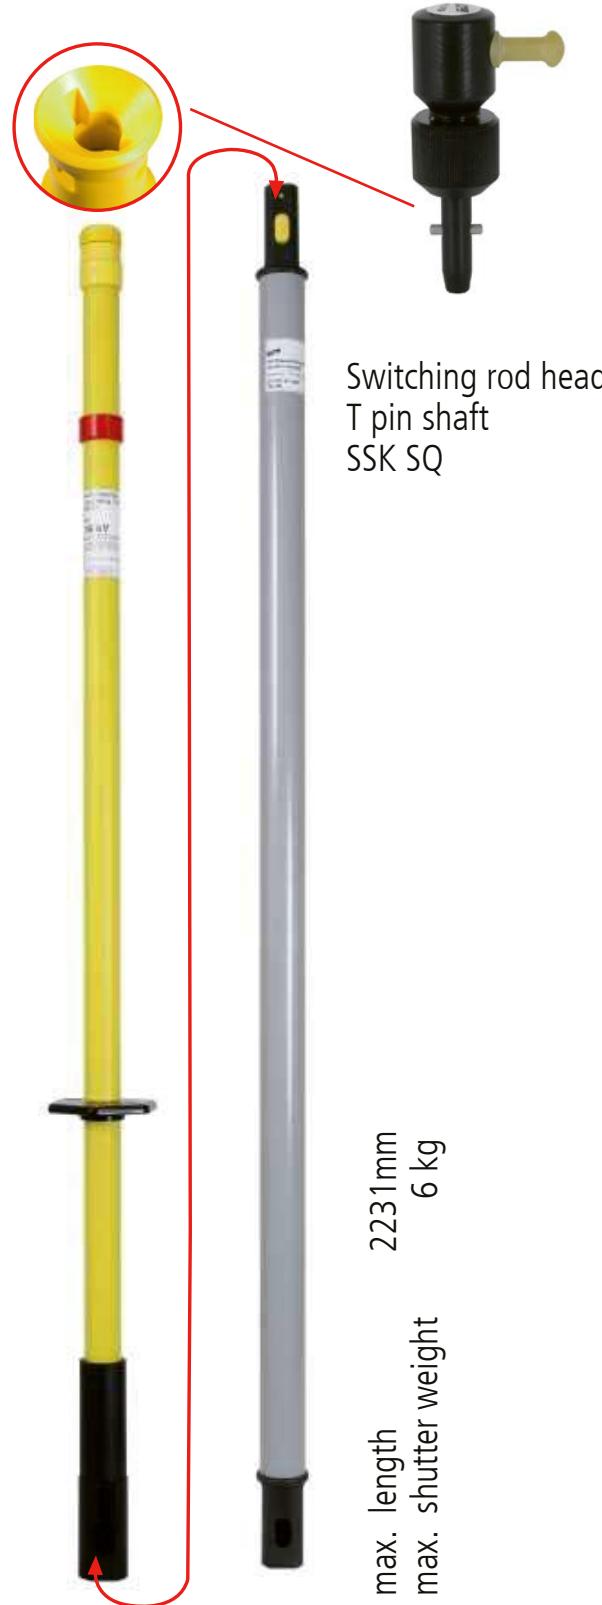

4.1.2 Possible combinations, IS... insulating rod used as switching rod


Combination A

1 HV STK 30 710 extension handle +
IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod
+ SSK M12 oder SSK SQ switching rod head

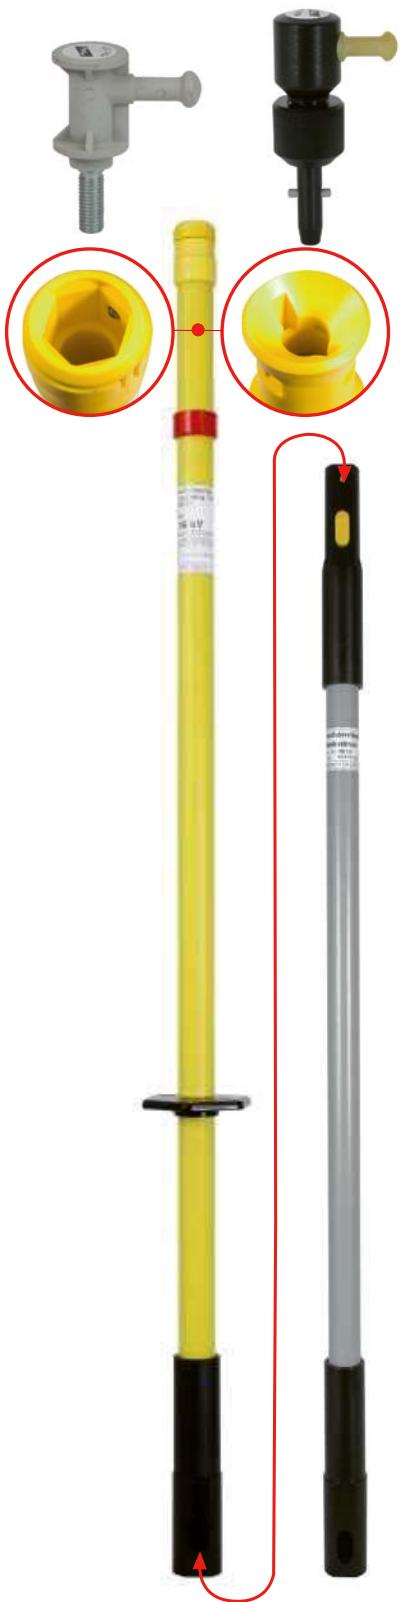

Combination B


1 HV STK 43 910 extension handle
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod
+ SSK M12 oder SSK SQ switching rod head

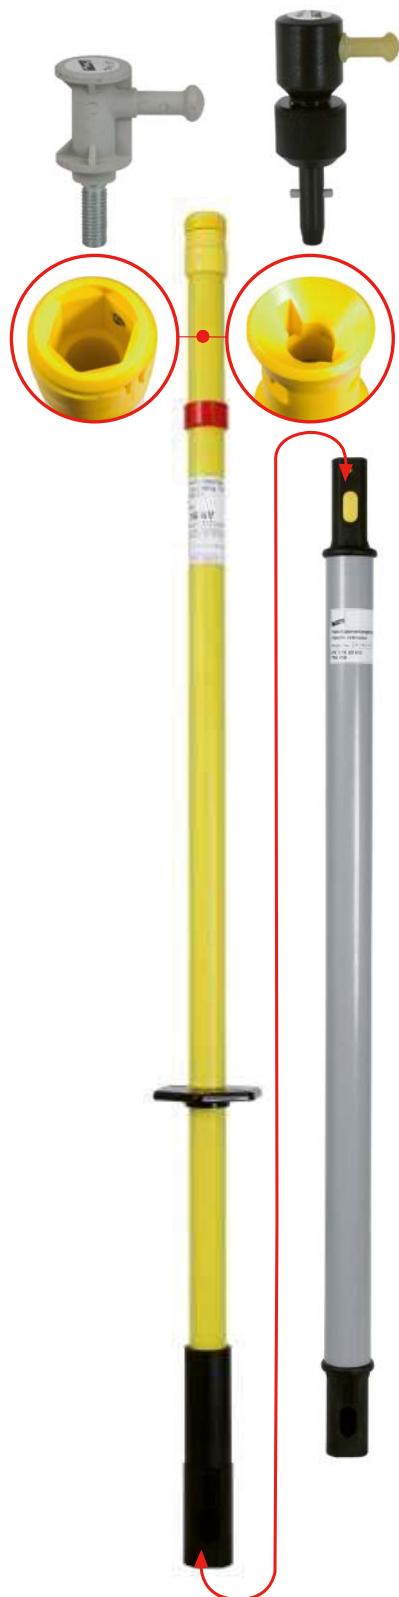

Possible combinations, IS ... insulating rod used as switching rod

Combination C


HV STK 43 1280 extension handle
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod
+ SSK M12 or SSK SQ switching rod head

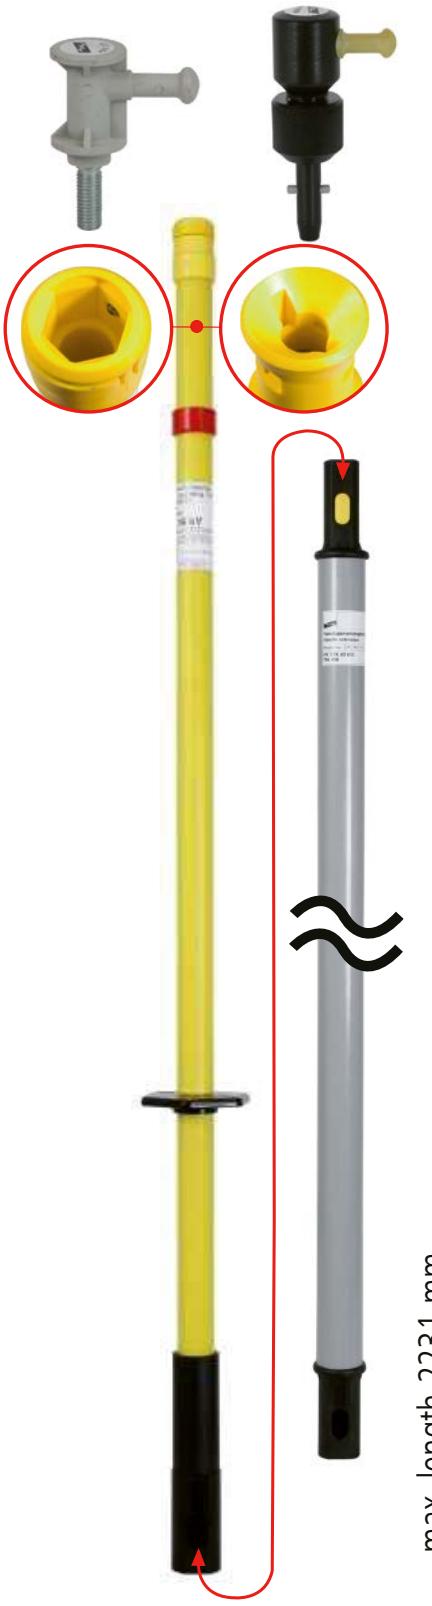

4.1.3 Possible combinations, IS ... insulating rod used as earthing rod

Combination A


1 HV STK 30 710 extension handle
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod

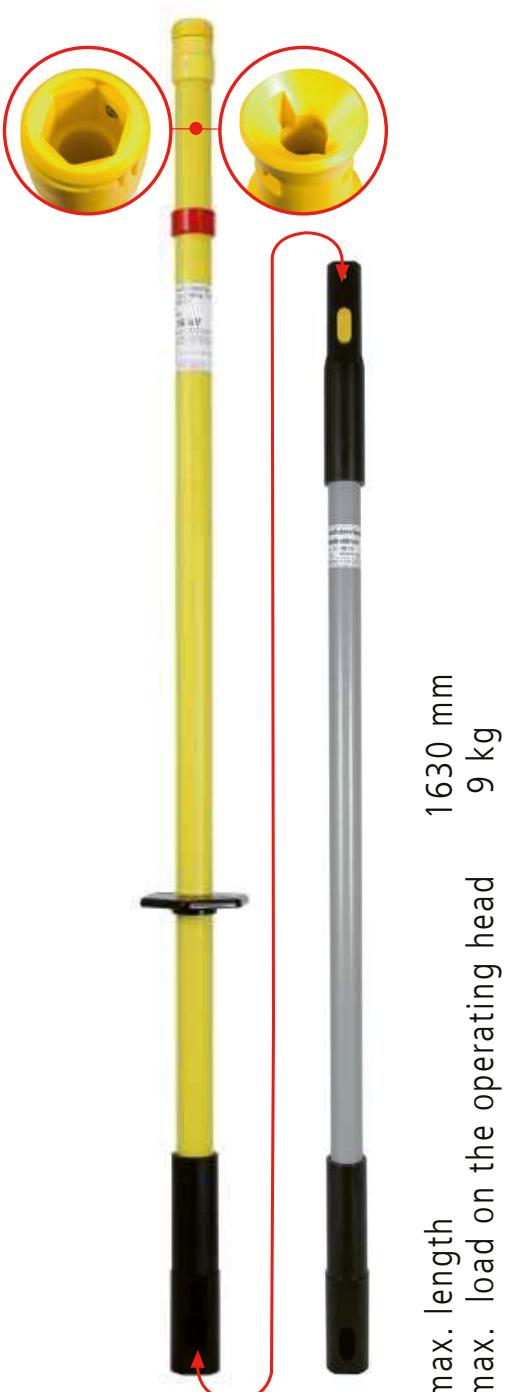

Possible combinations, IS ... insulating rod used as earthing rod

Combination B

1 HV STK 43 910 extension handle
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod

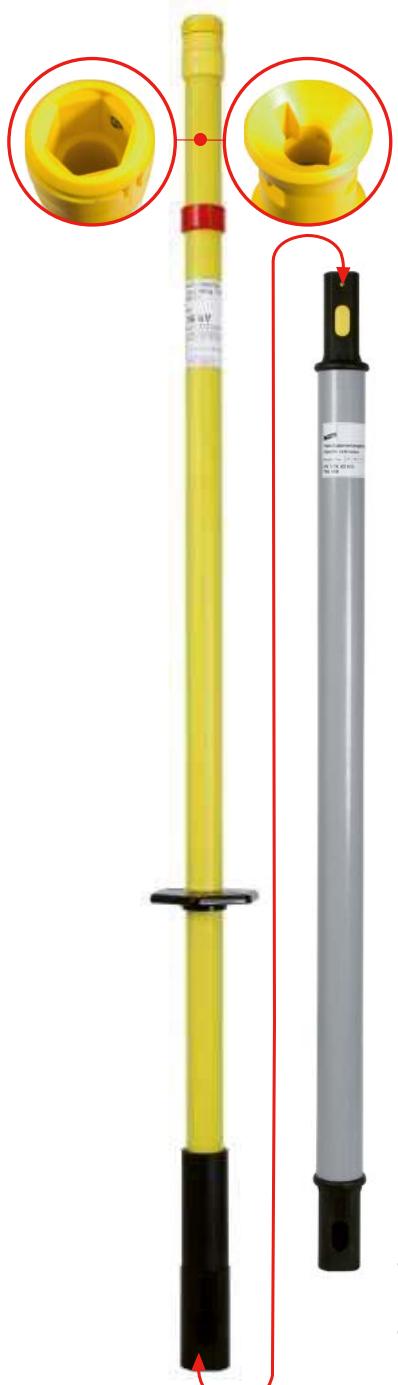

max. length
max. load on the operating head

1834 mm
9 kg

Combination C

2 HV STK 43 910 extension handles
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod




max. length
max. load on the operating head

2692 mm
5 kg

Possible combinations, IS ... insulating rod used as earthing rod

Combination D


1 HV STK 43 1280 extension handle
+ IS 36 SK STK 1000 insulating rod or
IS 36 SQ STK 1000 insulating rod

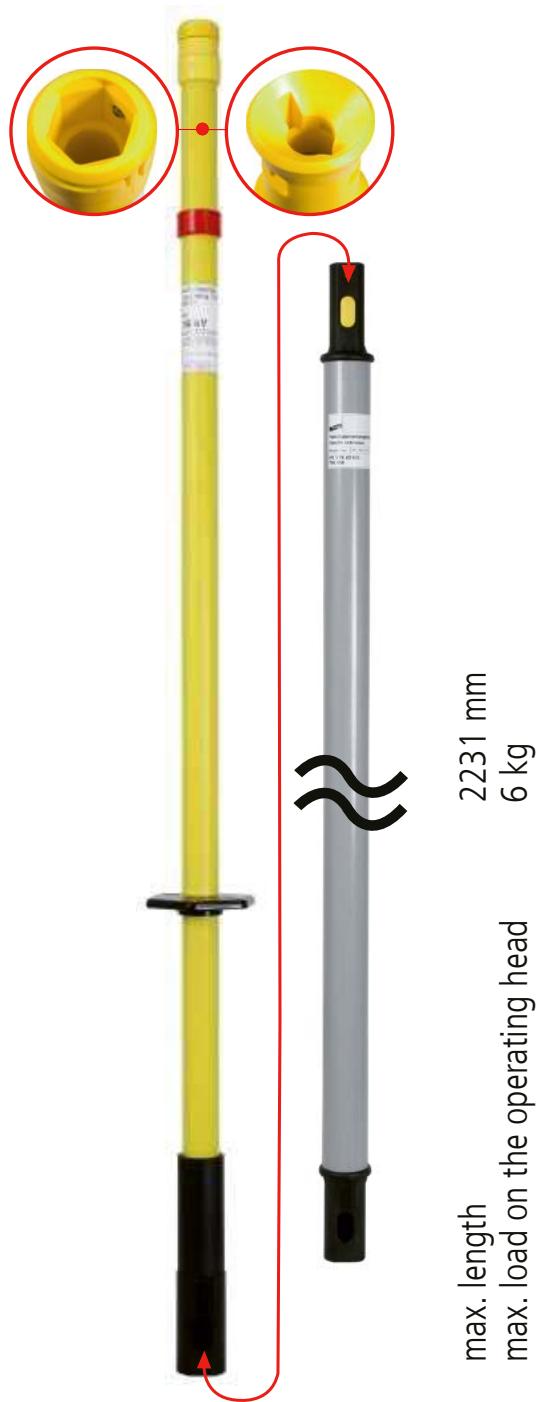

4.2 Possible combinations, IS 123 SQ STK 2000 insulating rod used as operating rod for inserting insulating protective shutters type A3 (T pin shaft) or rotatable shutters


Combination A

HV STK 30 710 extension handle +
IS 123 SQ STK 2000 insulating rod

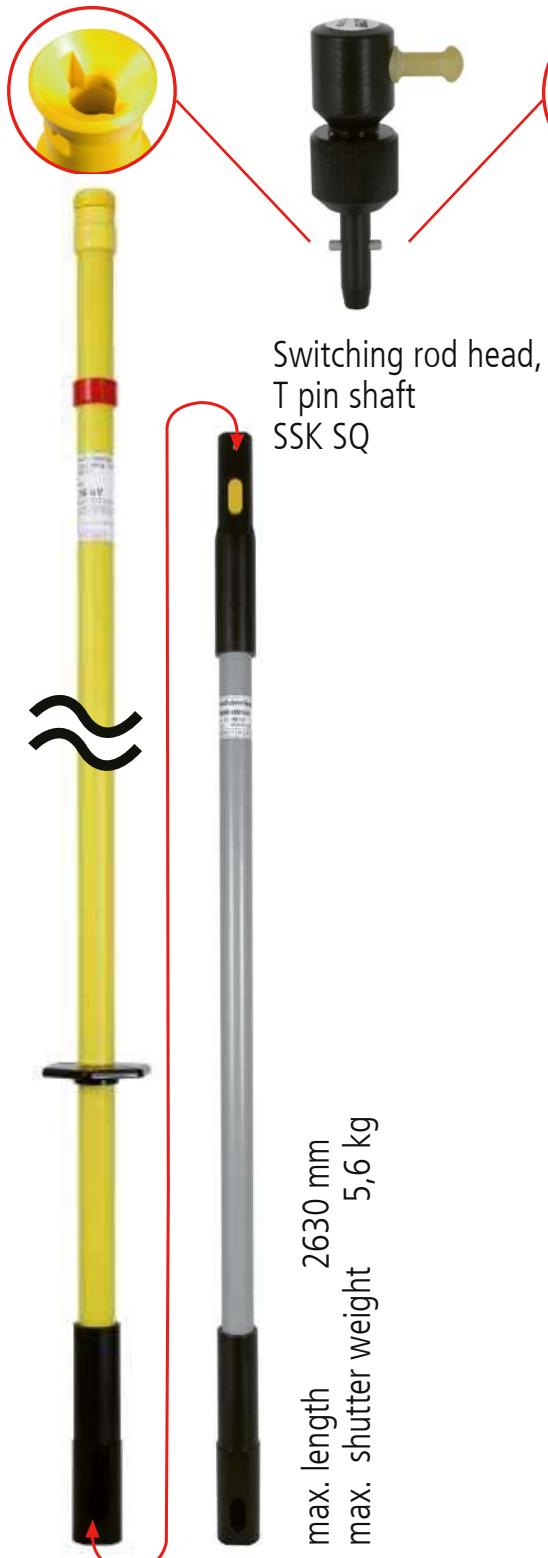

Combination B


HV STK 43 910 extension handle +
IS 123 SQ STK 2000 insulating rod

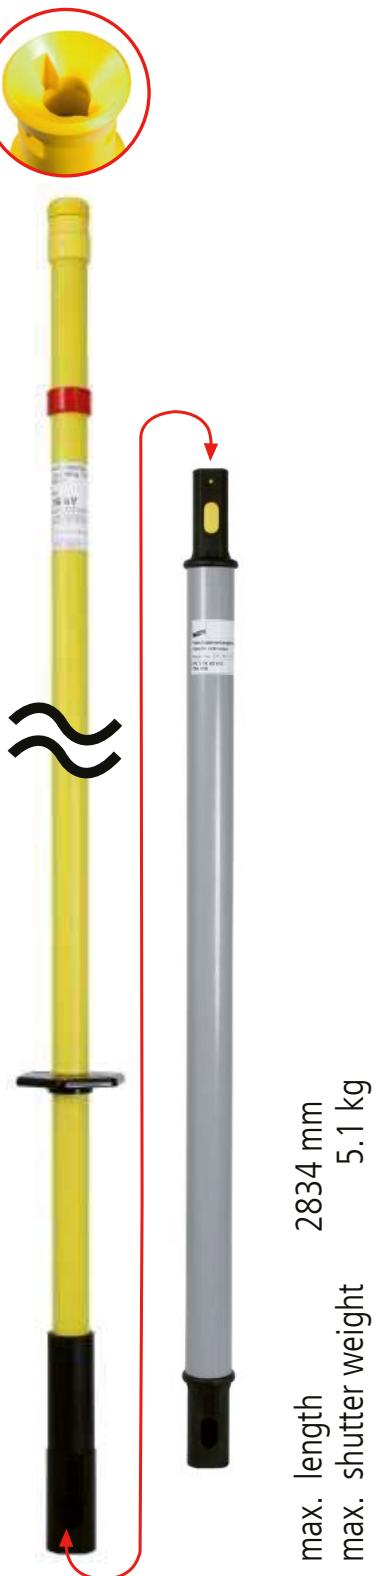

Possible combinations, IS 123 SQ STK 2000 insulating rod used as operating rod for inserting insulating protective shutters, type A3 (T pin shaft) or rotatable shutters

Combination C


HV STK 43 1280 extension handle +
IS 123 SQ STK 2000 insulating rod

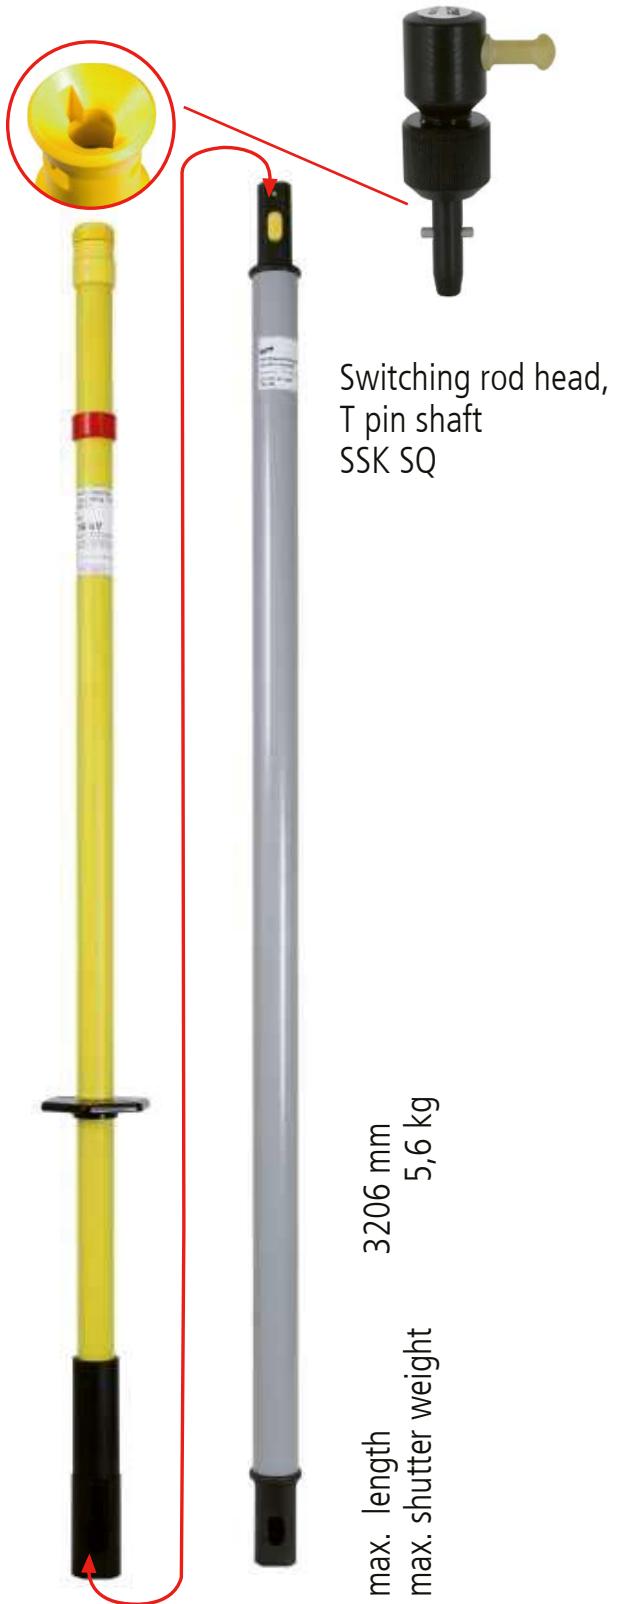

Possible combinations, IS... insulating rod used as switching rod

Combination C


HV STK 43 1280 extension handle
+ IS 123 SK STK 2000 insulating rod or
IS 123 SQ STK 2000 insulating rod
+ SSK M12 or SSK SQ switching rod head

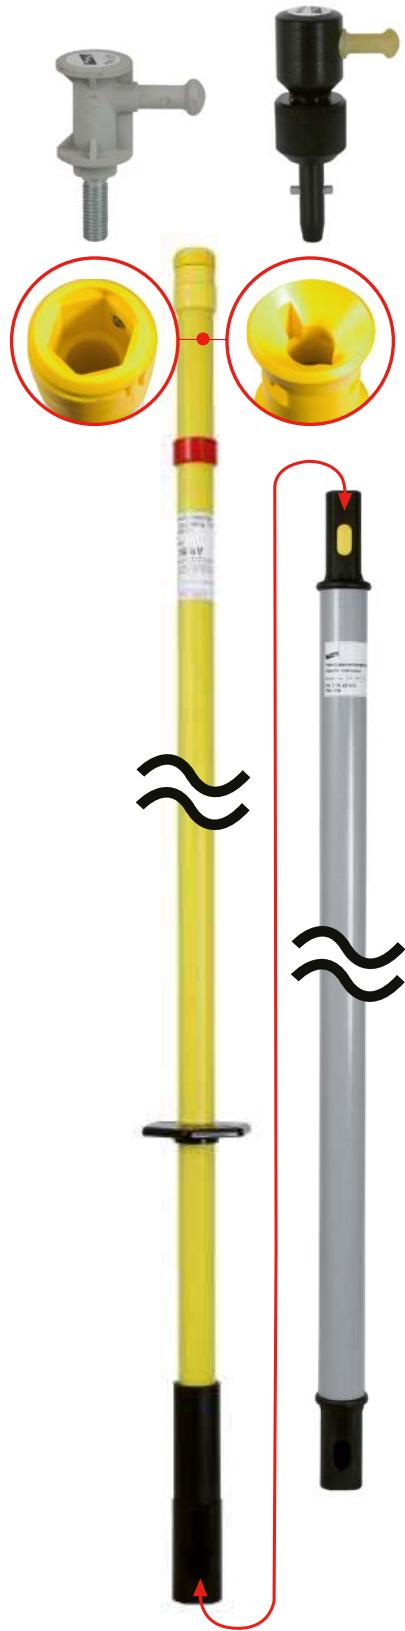

4.2.2 Possible combinations, IS 123 ... insulating rod used as switching rod

Combination A


1 HV STK 30 710 extension handle
+ IS 123 SK STK 2000 insulating rod or
IS 123 SQ STK 2000 insulating rod

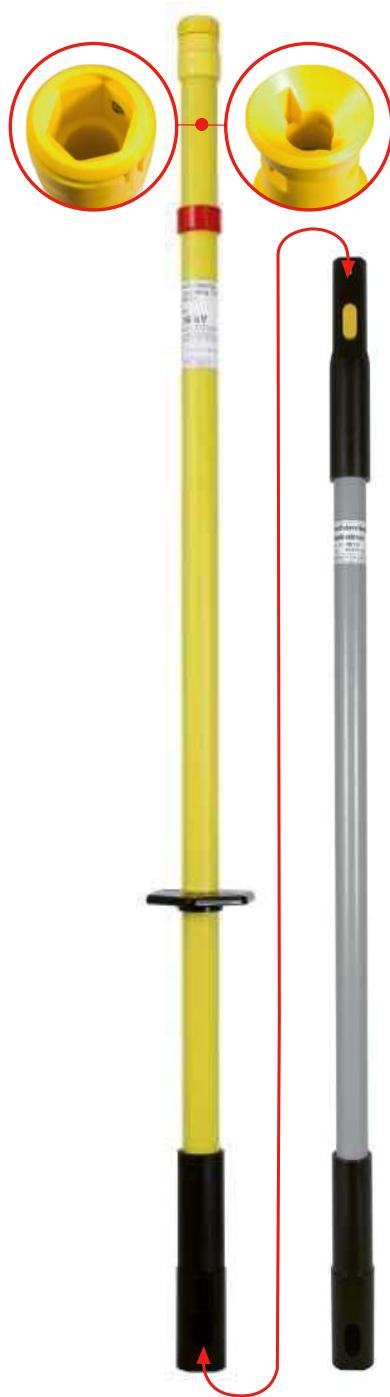

Possible combinations, insulating rod IS 123 SK STK 2000 or IS 123 SQ STK 2000 used as earthing rod


Combination B

1 HV STK 43 910 extension handle
+ IS 123 SK STK 2000 insulating rod or
IS 123 SQ STK 2000 insulating rod

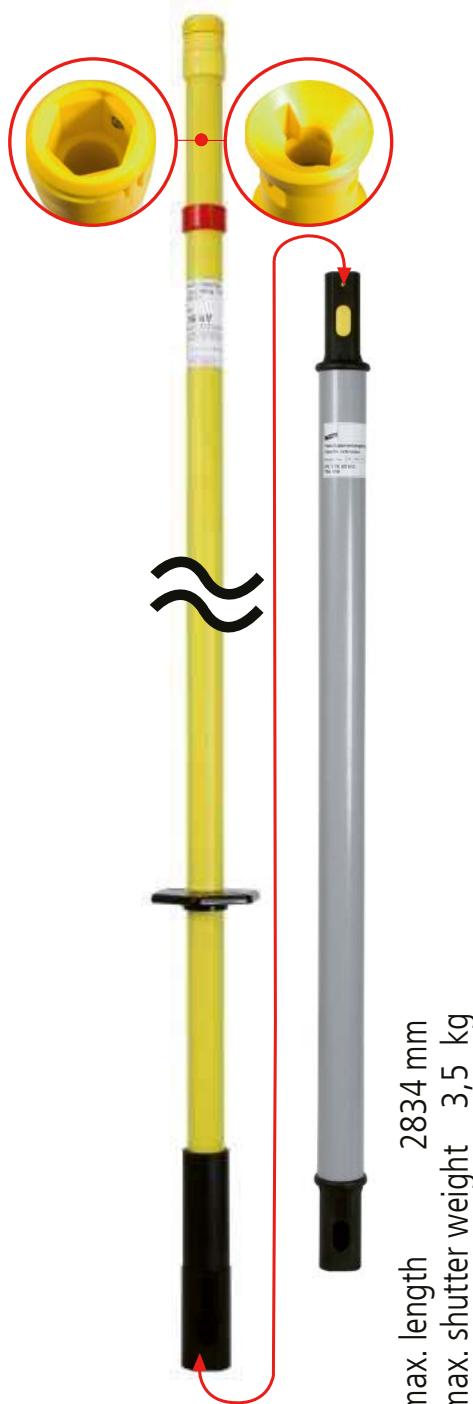

Combination C

1 HV STK 43 1280 extension handle
+ IS 123 SK STK 2000 insulating rod or
IS 123 SQ STK 2000 insulating rod

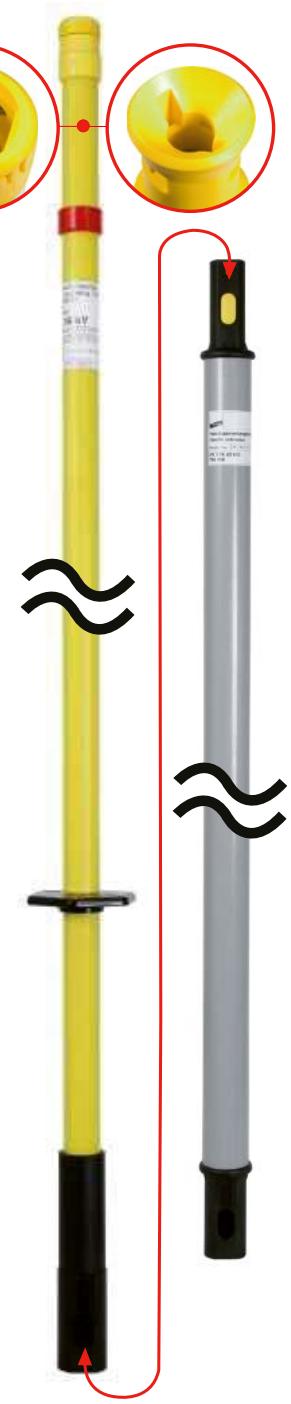

5. Maintenance test

It is advisable to test the IS ... insulating rods for discharge currents and protection against bridging at defined intervals in accordance with DIN VDE 0681 Part 1.

It is advisable to test SSK M12 and SSK SQ switching rod heads for protection against bridging at defined intervals in accordance with DIN VDE 0681 Part 1.

The intervals for maintenance tests depend on the operational conditions, e.g. frequency of use, environmental conditions, transport. It is advisable to perform a maintenance test at least every 6 years.

6. Cleaning and care

Basically, IS ... insulating rods and their accessory parts have to be handled with care. Clean soiled parts with a lint-free, damp cloth (e.g. washleather) before and after use. Only the following approved cleaning agents or solvents must be used:

- Florin 2000 (FLORE, Koblenz / Germany)
- Rivolta, B.W.R. 210 (Bremer & Leguil GmbH, Duisburg / Germany)

The manufacturer's instructions have to be observed.

When cleaning the single parts with cleaning liquids, adequate safety measures have to be taken. The regulation on flammable liquids has to be adhered to, especially the

- Smoking ban**
- Handling and storage of flammable liquids, etc.**

Before using the insulating rod, visually check whether the cleaning liquid on the equipment has evaporated.

7. Transport and storage

IS... insulating rods and their accessory parts have to be stored and transported in such a way that its performance characteristics will not be diminished.

7.1 Transport

IS... insulating rods and their accessory parts have to be stored in the appropriate KLT 133 34 10 artificial leather bag, Part No. 766 996.



7.2 Storage

- Store the equipment in enclosed rooms or vehicles.
- Relative air humidity: 20 to 96%
- Air temperature: -25°C - +70°C
- No direct sunlight

7.3 Protection against UV radiation

Some insulating materials are sensitive to ultraviolet radiation. Therefore insulating equipment should not be exposed to direct sunlight longer than necessary.

Please retain these instructions together with the relevant IS ... insulating rod for future reference!

**Surge Protection DEHN SE + Co KG
Lightning Protection
Safety Equipment
DEHN protects.**

**Hans-Dehn-Str. 1
Postfach 1640
92306 Neumarkt
Germany**

**Tel. +49 9181 906-0
www.dehn-international.com**