

New surge protective devices



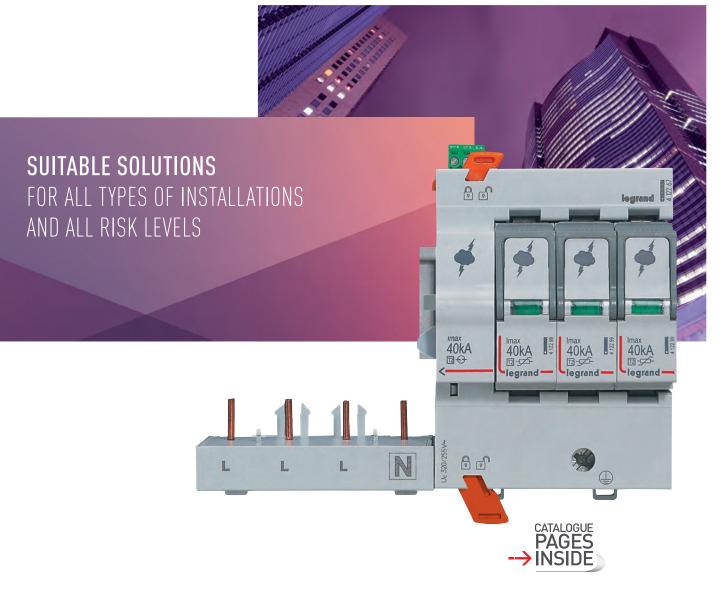

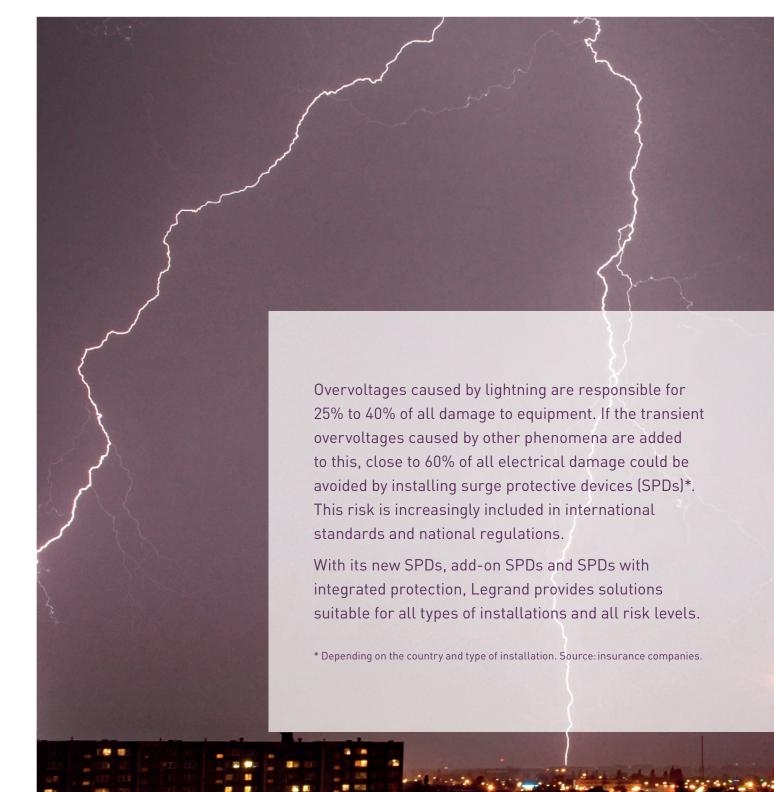

Llegrand

New Surge Protective Devices (SPDs)


2	new Legrand SPDs, a complete range for all risk levels
4	Optimum protection and adaptability to suit local habits
6	Add-on SPDs, increased reliability and safety
8	Design and functionality, perfect integration in distribution boards

New SPDs, a complete range for all risk levels

For protection against transient overvoltages to be effective, the position of the SPD in the installation and the type of SPD must be appropriate for the level of risk. Conforming fully to international standards, Legrand's range of type 1 (T1+T2) and 2 (T2) SPDs meet all the requirements of low voltage installations.



These SPDs require associated protection by means of a circuit breaker or fuse. They are designed to protect commercial and industrial installations. The protective circuit breaker is connected directly to the SPD with no wiring (see page 13). These SPDs are designed to protect commercial and industrial installations in their secondary distribution boards.





SPDs WITH INTEGRATED PROTECTION (T2)

Protection against overloads and shortcircuits is incorporated in the SPD. This is the most straightforward choice for small commercial or residential installations. It also provides the warranty of having the ideal match between the SPD and its associated protection, for maximum safety.


STANDARDS EN 61643-11 AND IEC 61643-11

The entire range of Legrand SPDs conforms to standards EN and IEC 61643-11. The standards distinguish two types of SPD for distribution boards: T1 and T2.

T1 SPDs are designed to provide protection in the main distribution boards and T2 SPDs mostly provide protection in secondary distribution boards or consumer units. T1+T2 SPDs, which are increasingly used at the supply end of installations, comply with the specifications of both T1 and T2 SPDs.

CASCADED PROTECTION

The only way to discharge all the initial energy is to install SPDs at every level of the installation.



Optimum protection and adaptability to suit local habits

The new Legrand 1P+N and 3P+N SPDs ensure optimum protection for electronic equipment, while providing a universal solution suited to the installation practices of all markets. Available with all levels of discharge current.





OPTIMUM PROTECTION

The 1P+N and 3P+N SPDs with dedicated protection of the neutral pole discharge the common and differential mode overvoltages that may occur in installations with TT and TNS systems, when there is a lightning strike.



1 Dedicated protection of the neutral

<u>SPDS...</u> <u>NOT JUST PROTECTION AGAINST</u> THE EFFECTS OF LIGHTNING

The operation of distribution networks, installations and equipment can cause very harmful transient overvoltages. As well as providing protection against the effects of lightning, installing SPDs also protects sensitive equipment against this type of disturbance.

ADAPTABILITY


To adapt to the installation practices of different countries, the 1P+N and 3P+N SPDs are available with the neutral on the right or on the left side.






Neutral on the right

Neutral on the left



Typical switching overvoltage

Add-on SPDs, increased reliability and safety

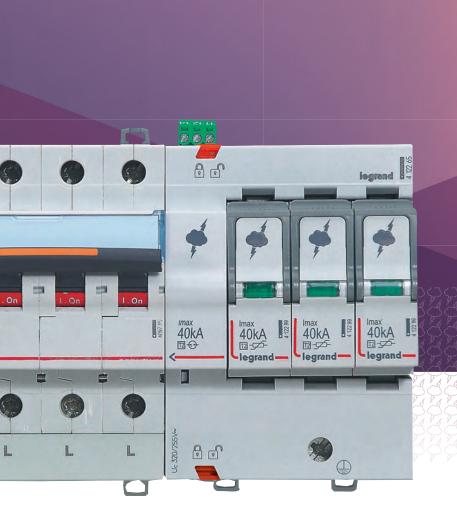

Exclusive to Legrand, the add-on SPDs make installation and maintenance simpler and safer and enable the associated circuit breaker to be chosen according to the back-up or discrimination requirements of the installation.

8 0

40kA

40kA

legrand

12-5

SAVE INSTALLATION TIME

The add-on SPD and its protective circuit breaker are joined together without any wiring, guaranteeing speed of installation and safety.

SIMPLER MAINTENANCE AND INCREASED SAFETY

• The circuit breaker + add-on SPD assembly is joined together by a locking system.

• A single auxiliary to ascertain the status of the SPD (operational or plug-in modules out of service) and its associated circuit breaker.

• It is not possible to reset the circuit breaker if a plug-in module is missing or out of service.


• If a plug-in module is out of service, the circuit breaker remains ON and the SPD can still protect the other poles.


MORE FLEXIBILITY DUE TO THE CHOICE OF CIRCUIT BREAKERS

The add-on SPD can be used with all DX³ 1 module per pole circuit breakers, thus enabling users to choose the characteristics of the protective device, which is not possible with SPDs with integrated protection.


INCREASED RELIABILITY AND MORE EFFECTIVE PROTECTION

With no intermediate wiring between the SPD and the circuit breaker, it is easier to create the shortest possible connection between the supply terminal block and the main terminal block for protective conductors, which provides more effective protection of the equipment





Main terminal block for protective conductors (PE)

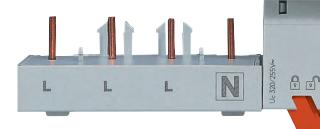

The add-on SPD is joined to the circuit breaker simply by driving in these two locking devices.

1

Design and functionality, perfect integration in distribution boards



Easier to handle: the plug-in modules are easy to replace thanks to the extraction handles.

40kA

legrand

40kA

40kA

122.99

STATUS INDICATOR AND REMOTE MONITORING OF INFORMATION


A plug-in module status indicator indicates whether the SPD is operational (green) or out of service (orange). The fault signal contact integrated in all add-on SPDs and available for all protection levels of conventional SPDs provides remote monitoring of this information. The fault signal contact on the add-on SPDs also indicates the status of the circuit breaker (ON/OFF).



Fault signal contact
 Status indicator

DESIGN AND MARKING

New design in line with the DX³ range of circuit breakers, but with dedicated marking for easy identification of the product once installed in the distribution board.

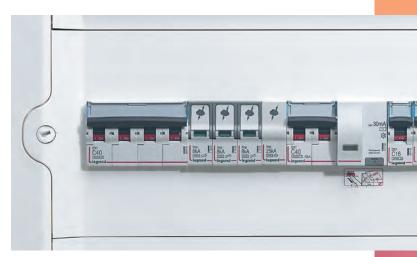



3 Dedicated marking for easier identification and maintenance of the SPDs.




9

Selecting Surge Protective Devices (SPDs) and their associated protection

SPDs are mandatory¹ for buildings:

- With risks for the persons: buildings with safety services or medical care facilities, hospitals, ...
- Dedicated to public services, cultural heritage, religious buildings,...
- With professional activities: commercial buildings, hotels, banks, industries, farms,...
- Equipped with a LPS (Lightning Protection System: protection of buildings against direct lightning strikes) and/or designed according to IEC/EN 62035 standard - With large number of persons: large residential, offices, schools, (Mandatory in Europe according to HD 60364)
- Small buildings: small commercial buildings, houses, small
- multi-family buildings, according to a risk analysis¹

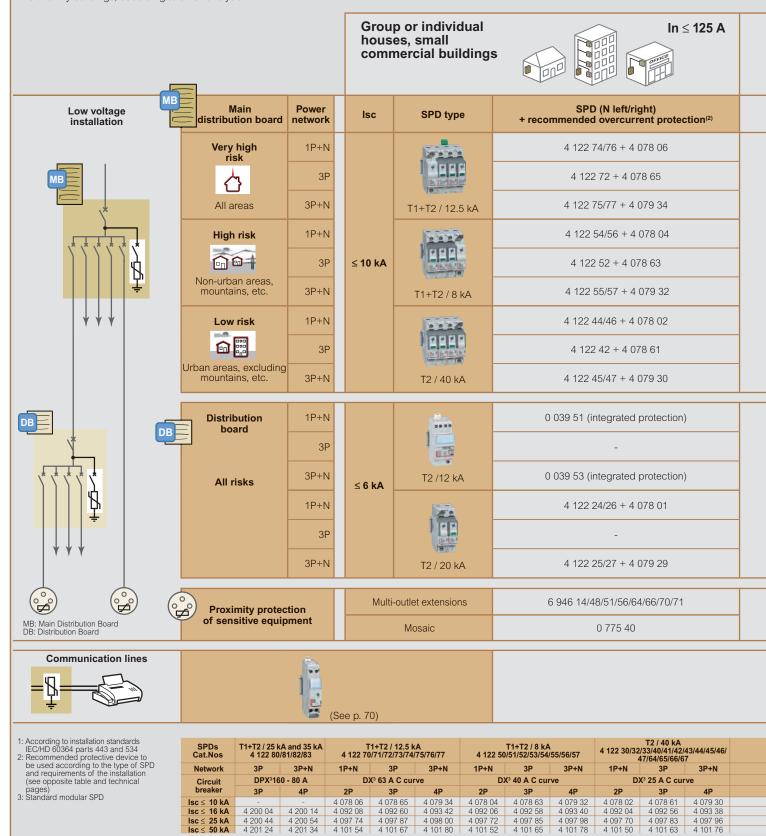

L legrand

Risk level	s:	conductor), installations of this installations of this installations of body of water, trees or n	that are outside o lear inst	isolated, or on a of urban areas, allations equipp	a high moun in mountain ped with ligh	tain, or have ous areas, i itning condu	etal structure (acting as a lightning a history of lightning strikes, etc. solated, at the end of a line, near a uctors, etc. s, or low and medium height		
	Commercial In ≤ 400 A			Large commercial/ Industrial buildings (IT earthing system: see below)					
lsc	SPD type	SPD (N left/right) + recommended overcurrent protection ⁽²⁾	Is	c SPI) type	+ recomi	SPD (N left/right) mended overcurrent protection ⁽²⁾		
	T1+T2/25 kA	- 4 122 82 + 4 200 44 4 122 83 + 4 200 54			2/25 kA		- 4 122 82 + 4 201 24 4 122 83 + 4 201 34		
≤ 25 kA		- 4 122 72 + 4 097 87	≤ 50				- 4 122 82 + 4 201 24		
	T1+T2/12.5 kA	4 122 75/77 + 4 098 00 - 4 122 72 + 4 097 87 4 122 75/77 + 4 098 00			2/25 kA		4 122 83 + 4 201 34 - 4 122 72 + 4 101 67 4 122 75/77 + 4 101 80		
≤ 10 kA	T2 / 12 kA	0 039 71 (integrated protection) - 0 039 73 (integrated protection)			T1+T2/12.5 kA		-		
≤ 16 kA	T2/20 KA	4 122 60/62 + 4 092 03 4 122 42 ⁽³⁾ + 4 092 55 4 122 61/63 + 4 093 37	≤ 25	(40 kA	4 122 64/66 + 4 097 70 4 122 42 ⁽³⁾ + 4 097 83 4 122 65/67 + 4 097 96			
	Mosaic	0 775 40		Mosaic			0 775 40		
When low voltage SPDs are present, protection of all lines entering the building is recommended IT earthing system (all risks)									
4 122 20/24	T2 / 20 kA /23/24/25/26/27/60/61/62/63			PD type	Network	lcc	SPD + protective device ⁽²⁾		
4 122 20/21 1P+N	/23/24/25/26/27/60/61/62/63 3P 3P+N			T1+T2	3P		4 122 80 (x 3) + 4 201 24		
	DX ³ 20 A C curve		MB	35 kA/440 V	3P+N	50 kA	4 122 80 (x 4) + 4 201 34		
2P	3P 4P				1P+N		4 122 30 (x 2) + 4 097 70		
4 078 01	4 078 60 4 079 29				20				
	4 078 60 4 079 29 4 092 55 4 093 37 4 097 82 4 097 95		DB	T2 40 kA/440 V	3P	25 kA	4 122 32 + 4 097 83		

Class I + II (T1+T2) low voltage SPDs



Technical characteristics p. 15-17

Protection against transient overvoltagess for 230/400 V $_{\odot}$ power networks (50/60 Hz). SPDs compliant with EN/IEC 61643-11 standards Recommended for main distribution boards Class I+II (T1+T2) : SPDs tested and specified according to both T1 and T2 test classes

Pack	Cat.Nos		PDs for general protection of main listribution board				Pack	Cat.Nos	SPDs for high risk level installations (continued)
					status indi	cators:			T1 + T2 - limp 25 kA/pole
		- Orange:	PD operati plug-in mo ystems: TT	dules to be					Up: 1.5 kV - Uc: 350 V∿ Earthing systems: TT, TNC, TNS. Recommended MCCB: DPX³160 - 80 A
			2 - limp 12,5 kA/pole			1	4 122 81 ¹	1P+N Right 50 kA Yes 4	
		protection	For general protection of big installations and protection of small installations with external lightning protection (LPS).				1 1	4 122 82 4 122 83 ¹	3P - 75 kA Yes 6 3P+N Right 100 kA Yes 8
		Up: 1.5 kV): 1.5 kV - Imax: 60 kA/pole - Uc: 320 V∿ lecommended MCB: DX³ 63 A - C curve						Replacement plug-in modules
					Remote		1	4 123 02	For SPDs T1+T2 - 8 kA
		Number of poles	Neutral position	Itotal (10/350)	status monitoring (FS contact)	Number of modules	1	4 123 03	Cat.Nos 4 122 50/51/52/53/54/55/56/57 For SPDs T1+T2 - 12.5 kA Cat.Nos 4 122 70/71/72/73/74/75/76/77
1 1 1	4 122 70 4 122 74 ¹ 4 122 76 ¹	1P 1P+N 1P+N	- Left Right	12.5 kA 25 kA 25 kA	No Yes Yes	1 2 2 2	1	4 122 84	For SPDs T1+T2 - 25 kA Cat.Nos 4 122 81/82/83 and 0 030 20/22/23/27
1 1 1	4 122 71 4 122 72 4 122 75 ¹	2P 3P 3P+N	- Left	25 kA 37.5 kA 50 kA			1	4 122 85	N-PE module for SPDs T1+T2 - 25 kA Cat.Nos 4 122 81/83 and 0 030 23
1	4 122 77 ¹	3P+N	Right	50 kA	Yes	4 4	1	4 122 86	For SPDs T1+T2 - 35 kA Cat.No 4 122 80
1	4 122 73	4P	-	50 kA	No	4			Cabling accessories
	T1+T2 - limp 8 kA/pole SPDs for small installations without external lightning protection (LPS) Up: 1.3 kV - Imax: 50 kA/pole - Uc: 320 V Recommended MCB: DX ³ 40 A - C curve					1	4 123 10	Ready to use cabling kit consisting of 5 conductors (including the earth conductor) Cross section :16mm ² Lenght : 40cm For cabling SPDs in industrial enclosures	
1 1 1 1 1 1	4 122 50 4 122 54 ¹ 4 122 56 ¹ 4 122 51 4 122 52 4 122 55 ¹ 4 122 57 ¹ 4 122 53	1P 1P+N 1P+N 2P 3P 3P+N 3P+N 4P	Left Right Left Right	8 kA 16 kA 16 kA 25 kA 25 kA 25 kA 32 kA	No No No No No No	1 2 2 3 4 4 4			(for EN/IEČ 61439 compliance). 1: 1P+N and 3P+N: L-N and N-PE protection modes (common and differential modes), the N pole being protected by encapsulated spark gaps. Also called 1+1 and 3+1
		SPDs for	r <mark>high ris</mark> l	k level in	stallation	s			
	SPDs for big installations with external lightning protection (LPS) and for high risk level installations according to EN/IEC 62305 standards SPDs with plug-in modules and status indicators: - Green: SPD operational - Red: plug-in modules to be replaced								
T1 + T2 - limp 35 kA/pole - 440V \sim (IT) - Plug-in					DV \sim (IT) - I				
Up: 2.5 kV - Uc: 440 V~ Earthing systems: TT, TNC, TNS, IT Recommended MCCB: DPX ³ 160 - 80 A									
		Number of poles	Neutral position	ltotal (10/350)	Remote status monitoring (FS contact)	Number of modules			
1	4 122 80	1P	-	35 kA	Yes	2			

Class II (T2) low voltage SPDs



D Technical characteristics p. 15-17

Protection against transient overvoltagess for 230/400 V \sim power networks (50/60 Hz). SPDs compliant with EN/IEC 61643-11 standards Recommended for distribution boards

Pack	Cat.Nos	T2 add-on	SPDs			Pack	Cat.Nos	T2 SPDs			
		- Green: SPE - Orange: plu) operational	s and status in s to be replace	ed			- Green: SPE	ug-in module) operational ug-in modules		
		and maintena for increased Installation. To be equipp	ance cycles. I d reliability an	I safety during Prewired MCE d for quick an MCBs (1 modu	3 connexions d easy			T2 - Imax 40 kA/pole SPDs recommended for power installations Up: 1.7 kV - In: 20 kA/pole - Uc: $320 V_{\sim}$ Earthing systems : TT, TNC, TNS Recommended MCB: DX ³ 25 A - C curve			6
		T2 - Imax 40 kA/pole SPDs recommended for power installations Up: 1.7 kV - In: 20 kA/pole - Uc: 320 V \sim				1	4 122 40	Number of poles 1P	Neutral position	Remote status monitoring (FS contact) No	Number of modules 1
		Recommend	/e	1 1	4 122 44 ¹ 4 122 46 ¹	1P+N 1P+N	Left Right	No No	2 2		
		Number of poles	Neutral position	Remote status monitoring (FS contact)	Number of modules	1	4 122 41 4 122 42	2P 3P	-	No Yes	23
1 1	4 122 64 ¹ 4 122 66 ¹	1P+N	Left Right	Yes Yes	4 4	1	4 122 45 ¹ 4 122 47 ¹	3P+N 3P+N	Left Right	No	4
1 1	4 122 65 ¹ 4 122 67 ¹	3P+N 3P+N	Left Right	Yes Yes	8 8	1	4 122 43	4P	-	No	4
		Up: 1.2 kV - I Recommend	mended for si In: 5 kA/pole led MCB: DX ³	mall installatic - Uc: 320 V∿ 20A - C curv	/e			T2 - Imax 40 kA/pole - 440V \sim (IT) SPDs recommended for big installations Up: 2.1 kV - In: 20 kA/pole - Uc: 440 V \sim Earthing systems : TT, TNC, TNS, IT Recommended MCB: DX ³ 25 A - C curve			
1 1	4 122 60 ¹ 4 122 62 ¹	1P+N 1P+N	Left Right	Yes Yes	4	1 1	4 122 30 4 122 32	1P 3P		No Yes	1 3
1 1	4 122 61 ¹ 4 122 63 ¹		Left Right	Yes Yes	8 8	1	4 122 33	4P T2 - Imax 20	- k A /polo	Yes	4
								SPDs recom Up: 1.2 kV - Earthing sys	mended for si In: 5 kA/pole tems : TT, TN Ied MCB: DX ³	- Uc: 320 V√ C, TNS	
						1 1 1	4 122 20 4 122 24 ¹ 4 122 26 ¹	1P 1P+N 1P+N	- Left Right	No No No	1 2 2 2 4
						1	4 122 21 4 122 25 ¹	2P 3P+N	Left	No No	
						1 1	4 122 27 ¹ 4 122 23	3P+N 4P	Right -	No No	4
						1	4 122 99	For SPDs T2	22 40/41/42/43		
						1	4 123 00	N-PE module	e for SPDs T2 22 44/45/46/4		
						1	4 123 01	For SPDs T2 Cat.Nos 4 12	- 440 V		
						1	4 122 97	For SPDs T2		1/25/26/27/61	0/61/62/63
						1	4 122 98	N-PE module	e for SPDs T2 2 24/25/26/2	- 20 kA	0701702/03
								1. 1P+N and 3P-	-N. IN and N-PE	protection modes	common and

1: 1P+N and 3P+N: L-N and N-PE protection modes (common and differential modes), the N pole being protected by encapsulated spark gaps. Also called 1+1 and 3+1

Class II (T2) low voltage SPDs with integrated protection

SPDs for telephone lines

0 039 51		0 039 53		0 039 54		0 038 28		0 038 29				
D Teo	chnical ch	aracteristics p	. 15-17			D Tec	chnical ch	aracteristics p	o. 15-17			
overload SPDs cor	currents a npliant wit 100 V∿ pc	With plug-in - Green: SPD - Red: plug-in T2 self prote For installatic underground In: 10 kA/pol Earthing syst Cat. No. 0 03 incoming and the SPD) pro overvoltages Number of poles 1P+N	it currents 43-11 standar (50/60 Hz) for consum al and small c modules and operational n module nee ected SPDs - ons with low ri l power suppl e - Uc: 275 V cems: TT, TNS i9 51: SPD with d outgoing ter viding better	ner units commercial in status indica ed to be repla Imax 12 kA/ isk level (in ur lies, etc.) C S th Y connection rminals at the	tors: ced pole ban areas, on (both top of	Pack 1	Cat.Nos 0 038 28 0 038 29	Overvoltage telephones, RS485 netw Not compati SPDs neede installation v (TS/IEC 616 SPDs with s - Green: SPI - Orange: pl Compliant w "Analogue" etc.) In/Imax 5/10 kA "Digital" SF etc.)	elephone al e protection of modems, vide orks, measure ble with VDSI ed to provide of vhen low volta 43-12). tatus indicator D operational ug-in module vith EN/IEC 61 * SPD (STN, n Max. voltage(Uc) 170 V PD (unbundle	equipment si eo door entry ement loops, 	uch as phones, etc. tection of f present eplaced lards ed ADSL, No. of moc 1	, dules
1 1 1 5 5 5 5 5	0 039 74 0 039 28 0 039 34 0 039 39	boards Protection of With plug-in i - Green: SPD - Red: plug-i In: 10 kA/pol Earthing syst Cat. No. 0 03 incoming and the SPD, pro- overvoltages T2 self prote Number of poles 1P+N	sensitive equ modules and operational n module nee e - Uc: 275 V tems: TT, TNS 971: SPD with d outgoing terviding better ected SPDs - Neutral position Left Left tected SPDs 99 51/53 99 51/53 99 20/21/22/2 99 30/31/32/3 99 35/36/38	status indica d to be repla th Y connective minals at the protection ag Imax 12 kA/ Integrated protection Isc ≤ 10 kA Isc ≤ 10 kA modules	tors: ced on both top of ainst pole Number of Number of 2							

1: 1P+N and 3P+N: L-N and N-PE protection modes (common and differential modes), the N pole being protected by encapsulated spark gaps. Also called 1+1 and 3+1.

protection against transient overvoltages

Protection against lightning and overvoltages

Protection against the effects of lightning is essentially based on: Protecting buildings using a lightning protection system (LPS or lightning conductors) to catch lightning strikes and to drive the lightning current to earth.
The use of surge protective devices (SPDs) to protect equipment.

• The design of the earthing system (passive protection of the installation)

Throughout the world, there are millions of lightning strikes each day in the summer (up to 1000 lightning strikes/second). Lightning is responsible for 25% to 40% of all damage to equipment. When added to industrial overvoltages (switching overvoltages due to the operation of internal equipment), they account for more than 60% of all electrical damages, which can be prevented by installing SPDs (according to the country and type of installation - source: insurance companies). In some countries, and depending on the end use of the building, national regulations may always stipulate the installation of SPDs (for example, Germany, Austria, Norway, etc.). If there are no specific national regulations, SPDs are usually specified by national installation standards (based on HD/IEC 60364 international installation standards) and EN/IEC 62305 standards.

External lightning protection system (LPS) or lightning conductors: protection of buildings (EN/IEC 62305)

An external lightning protection system (LPS) protects buildings against direct lightning strikes. It is generally based on the use of lightning conductors (single rod, with sparkover device, meshed cage,

etc.) and/or the metallic structure of the building. If there is an LPS or if a lightning risk assessment has been carried out in accordance with EN/IEC 62305 standards, SPDs are generally required in the main distribution board (T1 or T1+T2 SPDs) and distribution boards (T2 SPDs). Determination of the SPDs in the main distribution board in accordance with EN/IEC 62305 and T2 / EC 61642 12 (if there is insufficient.

with EN/IEC 62305 and TS/IEC 61643-12 (if there is insufficient information available):

LPL ¹ : Lightning protection level	Total lightning current of the LPS	Min. value of Imp current of the SPD (T1 or T1+T2)	Usage practices	
I 200 kA		25 kA/pole (IT: 35kA min.)	Power installations	
П	150 kA	18.5 kA/pole	Rarely used	
III/IV 100 kA		12.5 kA/pole	Small installations	

1: LPL (Lightning Protection Level)

Surge protective device (SPD) (internal protection) The SPD

· Protects sensitive devices against overvoltages caused by lightning and industrial overvoltages, by limiting the overvoltages to values that are tolerated by the equipment

Limits the possible harmful consequences in terms of the safety of people (medical equipment installed in the home, security systems,

environmental systems, etc.)
Maximises the continuity of operation of equipment and limits production losses

SPDs and standards

Standards EN/IEC 61643-11

Туре	of SPD	Test waves				
EN 61643-11	IEC 61643-11	Test waves				
Type 1 (T1) Class I (T1)		limp: 10/350 μs (discharge current) In: 8/20 μs (nominal current, 15 shocks)				
Type 2 (T2) Class II (T2)		Imax: 8/20 μs (discharge current) In: 8/20 μs (nominal current, 15 shocks)				

T1+T2 SPDs: tested in accordance with both methods.

T1 or T1+T2 SPDs are increasingly used at the supply origin of installations, even when there is no lightning conductor, as they enable higher energies to be discharged and increase the service life the SPD.

HD/IEC 60364 electrical installation standards

According to articles 443 and 534 of HD/IEC 60364 standards from year 2015 and the TS/IEC 61643-12 guides, the use of SPDs in new or renovated buildings is compulsory for buildings with:

· Risks for human life, e.g. safety services, medical care facilities, hospitals.

• Public services and cultural heritage, e.g. loss of public services, data centres, museums, religious buildings, .

· Commercial or industrial activities, e.g. hotels, banks, industries, commercial markets, farms,

• With direct lightning protection and/or designed according to EN/IEC 62305-2 (with LPS: T1 or T1+T2 SPDs, limp \ge 12.5 kA)

• Receiving large number of persons, e.g. large residential, offices, schools, ... (Europe)

In the case of small buildings, e.g. small commercial buildings, houses, small multi-family buildings, ..., a risk analysis shall be realized (article 443.5). If this is not done, SPDs are made mandatory by HD/IEC 60364 installation standards.

Countries still following earlier versions of HD/IEC installation standards:


According to articles 443 and 534 of HD/IEC 60364 standards and the TS/IEC 61643-12 guides, the use of SPDs in new or renovated buildings is compulsory at the supply origin of the installation in the following cases

Buildings with lightning conductors or LPS (T1 or T1+T2 SPDs, limp ≥ 12.5 kA)
Buildings with totally or partially overhead power supplies in AQ2 geographical areas (article 443.3.2.1 - AQ2: Nk > 25, see map below) and based on a risk assessment taking into account the type of power supply to the building (article 443.3.2.2)
According to article 443.3.2.2, SPDs (Type 2) are also required in the following account in the following account in the following account in the following account is a set of the set o


following cases:

· Commercial/industrial buildings, public buildings and services, religious buildings, schools and large residential complexes, etc.
Hospitals and buildings containing medical equipment and/or safety services for people and property (fire alarm, technical alarms, etc.)

Important: it is advisable to install an SPD when the safety of people may depend on the continuity of service of equipment (even if this is not required by national standards). Although not compulsory according to national installation standards, an SPD should always be installed to protect the communication equipment when there is an SPD on the low voltage power network.

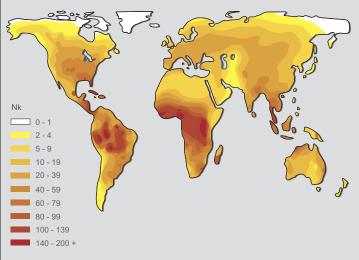

Protection of distribution boards and sensitive equipment (cascaded protection)



Effective protection against overvoltages cannot generally be assured with a single SPD if its protection level (Up) is greater than 1.2 kV (EN/IEC 62305 and TS/IEC 61643-12). When there are overvoltages, an SPD protects any invest by light the again of the sector. when there are overvoltages, an SPD protects equipment by limiting these overvoltages to values that can be tolerated by the equipment. Thus, depending on its discharge capacity (discharge current In, Imax, etc.) and its protection level (Up), an SPD will limit these overvoltages to varying values depending on the energy levels involved. The overvoltage values that may be transmitted downstream of the SPD may double over distances of more than 10 m due to resonances associated with the type of due to resonances associated with the type of electrical installation and the type of equipment. Overvoltages greater than 2.5 kV may then occur and damage equipment if the residual energy is high enough (2.5 kV being the insulation level of most electrical and electronic equipment, or typically 1.5 kV for electrical domestic appliances)

SPDs should be installed in the distribution boards supplying equipment that is sensitive or critical for the activity being carried out (and/or near to equipment with proximity SPDs).

Surge Protective Devices (SPDs)

technical characteristics

Modular SPDs

230/400 V√ power network (50/60 Hz) - Degree of protection IP 20 1P+N (3P+N) SPDs: L-N and N-PE protection, also called 1+1 (3+1 resp.) or CT2 type protection depending on installation standards.

				Nominal Max. discharge current Protection level			Max.		FS												
Cat.Nos	Туре	Poles	Earthing system	Max. voltage (Uc)	Protection mode	Nominai current In/pole (8/20)	lmax/ pole (8/20)	limp/pole (10/350)	l total (10/350)	Up (L-N/L-PE/N-PE)	Up at 5 kA	Max. short-circuit current Isc (Isccr)	Protective device to be used ¹	auxiliary (remote status monitoring)							
4 122 80	T1+T2/35 kA	1P	TT, TNC, TNS, IT	$440 V \sim$	CT1	35 kA	50 kA	35 kA	35 kA	2.5 kV				yes							
4 122 81	T1+T2/25 kA	1P+N	TT, TNS	350 V∿	CT2	25/50 kA	50/100 kA	25/50 kA	50 kA	1.5/2.5/1.5 kV		50 kA	DPX3160	yes							
4 122 82	T1+T2/25 kA	3P	TNC	350 V ~	CT1	25 kA	50 kA	25 kA	75 kA	1.5 kV			80 A	yes							
4 122 83	T1+T2/25 kA	3P+N	TT, TNS	350 V 🔨	CT2	25/100 kA	50/100 kA	25/100 kA	100 kA	1.5/2.5/1.5 kV				yes							
4 122 70	T1+T2/12.5 kA	1P	TT, TNC, TNS	320 V∿	CT1	25 kA	60 kA	12.5 kA	12.5 kA					no							
4 122 71	T1+T2/12.5 kA	2P	TT, TNS	320 V∿	CT1	25 kA	60 kA	12.5 kA	25 kA] 1.5 kV at 12.5 kA	4.137			no							
4 122 72	T1+T2/12.5 kA	3P	TNC	320 V∿	CT1	25 kA	60 kA	12.5 kA	37.5 kA	1.9 kV at 25 kA	1 kV	50.64	DX3 63 A	yes							
4 122 73	T1+T2/12.5 kA	4P	TT, TNS	320 V∿	CT1	25 kA	60 kA	12.5 kA	50 kA			50 kA	C curve	no							
4 122 74/76	T1+T2/12.5 kA	1P+N	TT, TNS	320 V∿	CT2	25/25 kA	60 kA	12.5/25 kA	25 kA	1.5/1.6/1.5 kV at 12.5 kA	1 kV			yes							
4 122 75/77	T1+T2/12.5 kA	3P+N	TT, TNS	320 V∿	CT2	25/50 kA	60 kA	12.5/50 kA	50 kA	1.9/2.1/1.5 kV at 25 kA	TKV			yes							
4 122 50	T1+T2/8 kA	1P	TT, TNC, TNS	320 V∿	CT1	20 kA	50 kA	8 kA	8 kA					no							
4 122 51	T1+T2/8 kA	2P	TT, TNS	320 V∿	CT1	20 kA	50 kA	8 kA	16 kA	1.2 kV at 8 kA	1 kV	1 41			no						
4 122 52	T1+T2/8 kA	3P	TNC	320 V∿	CT1	20 kA	50 kA	8 kA	25 kA	1.7 kV at 20 kA	1.7 kV at 20 kA	1.7 kV at 20 kA	INV	50 kA	DX ³ 40 A	no					
4 122 53	T1+T2/8 kA	4P	TT, TNS	$320 V \sim$	CT1	20 kA	50 kA	8 kA	32 kA			JUKA	C curve	no							
4 122 54/56	T1+T2/8 kA	1P+N	TT, TNS	320 V∿	CT2	20 kA	50 kA	8 kA	16 kA	1.2/1.5/1.5 kV at 8 kA	1 kV			no							
4 122 55/57	T1+T2/8 kA	3P+N	TT, TNS	320 V∿	CT2	20 kA	50 kA	8 kA	25 kA	1.7/2/1.5 kV at 20 kA	INV	NV .		no							
4 122 40	T2/40 kA	1P	TT, TNC, TNS	320 V \sim	CT1	20 kA	40 kA				50 kA	1 kV 50 kA 50 kA 50 kA 50 kA 50 kA DX ³ 25 A C curve		no							
4 122 41	T2/40 kA	2P	TT, TNS	320 V∿	CT1	20 kA	40 kA			1.5 kV at 15 kA	1 147		50 kA		no						
4 122 42	T2/40 kA	3P	TNC	320 V∿	CT1	20 kA	40 kA			1.7 kV at 20 kA	50 kA		DVC OF A	yes							
4 122 43	T2/40 kA	4P	TT, TNS	320 V∿	CT1	20 kA	40 kA]			A	no							
4 122 44/46 4 122 64/66	T2/40 kA	1P+N	TT, TNS	320 V∿	CT2	20 kA	40 kA			1.5/1.6/1.4 kV at 15 kA	1 kV 50 kA 25 kA 50 kA 25 kA]	no yes								
4 122 45/47 4 122 65/67	T2/40 kA	3P+N	TT, TNS	320 V∿	CT2	20 kA	40 kA			1.7/2/1.4 kV at 20 kA				no yes							
4 122 30	T2/40 kA	1P	TT, TNC, TNS, IT	440 V∿	CT1	20 kA	40 kA		1.8 k)/ of 15 kA	1.8 kV at 15 kA	1.8 kV at 15 kA		1010/-+4514		1.0 10/ at 15 1/0	1.9 kV ot 15 kA	1.8 kV at 15 kA			DX ³ 25 A	no
4 122 32	T2/40 kA	3P	TNC, IT	440 V∿	CT1	20 kA	40 kA			2.1 kV at 20 kA	1.3 kV	50 kA	C curve	yes							
4 122 33	T2/40 kA	4P	TT, TNS, IT	$440 V \sim$	CT1	20 kA	40 kA							yes							
4 122 20	T2/20 kA	1P	TT, TNS	320 V∿	CT1	10 kA	20 kA							no							
4 122 21	T2/20 kA	2P	TT, TNS	320 V∿	CT1	10 kA	20 kA			1.2 kV at 5 kA 1.4 kV at 10 kA	1.2 kV			no							
4 122 23	T2/20 kA	4P	TT, TNS	320 V∿	CT1	10 kA	20 kA					25 kA	DX ³ 20 A	no							
4 122 24/26 4 122 60/62	T2/20 kA	1P+N	TT, TNS	320 V∿	CT2	10/20 kA	20 kA			1.2/1.4/1.4 kV at 5 kA	1.2 kV	20 KA	C curve	no yes							
4 122 25/27 4 122 61/63	T2/20 kA	3P+N	TT, TNS	320 V∿	CT2	10/20 kA	20 kA			1.4/1.4/1.4 kV at 10 kA	1.2 KV			no yes							
0 039 51 0 039 71	T2+T3/12 kA	1P+N	TT, TNS	$275 V \sim$	CT2	10/10 kA	12 kA			1.1/1.2/1.2 kV at 10 kA	1 kV	6 kA 10 kA	integrated	no							
0 039 53 0 039 73	T2+T3/12 kA	3P+N	TT, TNS	$275 V \sim$	CT2	10/20 kA	20 kA			1.171.271.2 KV at 10 KA	1 KV	6 kA 10 kA	protection	no							

CT1: L(N)-PE protection modes. CT2: L-N and N-PE protection modes. 1: DPX³ (only T1 + T2 SPDs Cat.Nos 4 122 80/81/82/83), DX³ or similar type circuit breakers (with T2 and other T1+T2 SPDs). For fuse protection or values other than those indicated in the table: please consult Legrand.

Characteristics of proximity SPDs

230 V \sim protection: Type 3 (T3) SPDs

Cat.Nos	0 775 40	6 946 64/66/70	6 946 14/48/51/56/71
Protection mode	LN/NPE	LN/LPE/NPE	LN
Up	1/1.2 kV	1 kV	1 kV
Imax	6 kA	-	-
In	1.5 kA	2 kA	2 kA
Uoc	3 kV	4 kV	4 kV

TT earthing system: Installation downstream of a residual current device (HPI type recommended).

RJ 45/RJ 11 protection

Cat. No.	6 946 64 6 946 7 0					
Uc	200 V					
Up	600 V					
Imax	1.5	kA				
In	1 kA					
Uoc	3 kV					

TV protection (9.5 mm coax.)


Cat. No.	6 946 66
Uc	50 V
Up	900 V
Imax	5 kA
In	1 kA
Uoc	3 kV

Installation

Associated overcurrent protection

SPDs must be protected by a circuit breaker (or fuses), to provide protection in the event of an overload, which may make the SPD reach its end of life (see selection table p. 10-11). This protective device will be defined to be coordinated or discriminating with regard to upstream protective devices

Connection principles

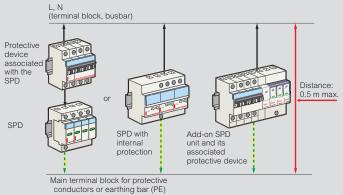


Connection lengths: as short as possible (< 50 cm if possible). EMC (Electromagnetic Compatibility) rules: avoid loops, fix the cables firmly against the exposed metal conductive parts of the enlcosure.

SPD types and earthing systems

When possible (according to local rules), the SPD and its associated overcurrent protection (P2) should be installed upstream of the main protection (P1) as shown below (according to standards HD/IEC 60364).

SPDs and TT earthing system

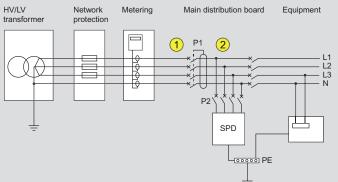


P1: main protection of the installation

SPD: surge protective device with Uc 275 or 320 V recommended (1) (upstream of P1): 1P+N/3P+N SPDs only (except for Cat.Nos 0 039 51/53/71/73). 1P/2P/3P/4P SPDs and Cat.Nos 0 039 51/53/71/73 must always be

installed downstream of a residual current device (discriminating or delayed, at the supply end of the installation).

2 (downstream of P1): any SPD.


SPDs and TN (TNC, TNS and TNC-S) earthing systems

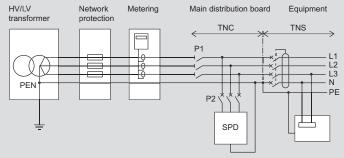

P1: main protection of the installation

SPD: surge protective device with Uc 275 or 320 V recommended

SPDs and IT earthing system

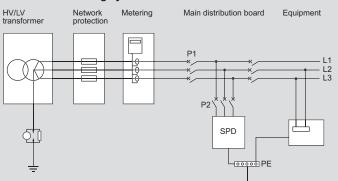

P1: main protection of the installation

SPD: surge protective device with Uc 440 V (Uc < 440 V prohibited)

Coordinating upstream/downstream SPDs

Consists of ensuring that any downstream SPD (in distribution enclosures or proximity SPDs) is correctly coordinated in energy terms with any SPD located upstream (TS 61643-12).


Minimum distances between SPDs

Upstream SPD	Downstream SPD	Minimum distance between SPDs (m)			
		With LPS	Without LPS		
T1+T2/35 and T1+T2/25	T2/40 (Uc 440V)	0	0		
11+12/35 and 11+12/25	T2/40 (Uc 320V)	1	0		
T1+T2/12.5 and T1+T2/8	T2/40	5	0		
11+12/12.5 and 11+12/6	T2/20 or T2/12	8	0		
T2/40	T2/20 or T2/12	-	1		
T2/20	T2/12	-	0.5		
T2/20 and T2/12	Proximity SPDs	-	2		


Installation for telephone lines

Protection of a telephone line


• Upstream the communication distribution box



- Downstream the communication distribution box
- Analogue or digital



- Digital



Llegrand

World Headquarters

and International Department 87045 Limoges Cedex - France Tel. : + 33 (0) 5 55 06 87 87 Fax: + 33 (0) 5 55 06 74 55

EXB14044 - November 2016



HELSINKI tel. +358 9 540 4940 info@klinkmann.fi

YEKATERINBURG

tel. +7 343 287 19 19 yekaterinburg@klinkmann.spb.ru

KIEV tel. +38 044 495 33 40 klinkmann@klinkmann.kiev.ua

RIGA tel. +371 6738 1617 klinkmann@klinkmann.lv **ST. PETERSBURG** tel. +7 812 327 3752 klinkmann@klinkmann.spb.ru

SAMARA tel. +7 846 273 95 85 samara@klinkmann.spb.ru

KAZAKHSTAN tel. +77779994825 sales@klinkmann.kz

VILNIUS tel. +370 5 215 1646 post@klinkmann.lt MOSCOW tel. +7 495 641 1616 moscow@klinkmann.spb.ru

UFA tel. +7 347 293 70 04 klinkmann@klinkmann.ru

MINSK tel. +375 17 200 0876 minsk@klinkmann.com

TALLINN tel. +372 668 4500 klinkmann.est@klinkmann.ee



www.klinkmann.com